



July 06, 2021

Reaffirmed March 11, 2024

Mr. Milton P. Nogueira Jr.  
Roof Tech Inc.  
10620 Treena St. Suite 230  
San Diego, CA 92131

Dear Mr. Nogueira,

Re: Roof Tech RT Mini II – Structural Review - for British Columbia, Canada – BCBC 2018 - Our file 20027

Thank you for retaining our office to carry out the structural review of the Roof Tech RT Mini II for use with the Rail Option to install Photovoltaic (PV) panels.

The purpose of the review was to assess the spacing requirement for the Roof Tech RT Mini II photovoltaic (PV) panel roof mount system used with the Rail Option. Our determination is that the system can be safely connected to roof structures in British Columbia according to British Columbia Building Code (BCBC) 2018 requirements for various site conditions and arrangements as detailed in the attached tables.

The review consisted of calculating the factored connection resistance of the Roof Tech RT Mini II for shear, downward force and tension based on load test results. These resistances were compared to the factored loading on the connection for various roof substrates, orientations of PV panel on a roof using the Rail Option, for various wind roof zones, terrains, and roof slopes. The maximum corresponding wind and snow environmental site parameters were then determined and the spacings of the mounts determined from an analysis of the capacities observed in load tests.

The analyses presumes that all connections and associated hardware are installed according to Roof Tech RT Mini II Installation Manual and accepted standards of practice for construction. All materials used shall be free of defects and wood substrates shall be according to the minimum thicknesses and grades specified in this report. The installation contractor is responsible for verifying the strength of the roof framing, the structural strength of the PV panels and the capacities of all materials supplied by others as a pre-condition for determining the suitability of use of these tables. Refer to Exhibit A for connection and panel mount orientation as prepared by Starling Madison Lofquist, Inc., for SML project report 471-13.

Kassian Dyck & Associates will not be liable for the failure of any manufactured product or any manufactured or factory assembled system of components to perform in accordance with the manufacturer's specifications, product literature or written documentation. This report was prepared by Kassian Dyck & Associates for Roof Tech Inc. The material in it reflects Kassian Dyck & Associates' best judgement in light of the information available to it at the time of preparation. Any use which a third party makes of this report, or any reliance on or decisions to be made based on it, are the responsibility of such third parties. Kassian Dyck & Associates accepts no responsibility for damages, if any, suffered by any third party as a result of decisions made or actions based on this report.

If you require any further information please contact the undersigned.

Prepared by:  
Subial Ali Asif, E.I.T

A handwritten signature in black ink, appearing to read 'Subial Ali Asif'.

Reviewed by:  
Wayne Kassian, Msc, P.Eng

Permit to Practice:  
1004161

Requested to re-stamp March 11, 2024  
Valid until British Columbia Building Code  
2024 in Effect

---

Project Name:	RT-MINI II-BC (BCBC2018)	Date :	18/05/2021	Design:	SA
---------------	--------------------------	--------	------------	---------	----

---

Project No.:	20027-T2	Description	Calculation of mount capacities	Checker:	MG
--------------	----------	-------------	---------------------------------	----------	----

---

## Table of Contents

Summary.....	3
System Description.....	3
Connection Load Tests.....	3
Table 1: Factored test resistance of roof wood substrates.....	4
Connection Load Analysis.....	4
Table 2: Roof Slope to Roof Angle Conversion.....	6
Wind Roof Zones .....	6
Results.....	6
Table 3: Meters to feet conversion .....	6
Provincial Range Of Environmental Loads.....	7
Table Notes for Tables RT1 to RT18 .....	7
RT Mini II - TABLES.....	8
EXHIBIT – A .....	119

---

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

---

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

---

## Summary

Four roof substrates were reviewed: a) 7/16" thick OSB on 2x4 SPF No. 2 rafter, b) 15/32" thick plywood on 2x4 SPF No. 2 rafter c) 7/16" thick OSB only, and d) 15/32" thick plywood. The Roof Tech RT Mini II is connected at each mount to the substrates as shown in Exhibit A. Load tests data from Institute of Building Technology (IBT) and Western Technologies Inc. (WTI) for each of these connection types was used to assess the spacing requirements of the mounts for the allowable range of regional climatic parameters from the BCBC-2018.

## System Description

The Roof Tech RT Mini II Photovoltaic Panel Roof Mount System consists of a 6000 Series aluminum base. An appropriately rated "L-Foot", by others, may be attached to the RT Mount Mini II base with a stainless steel SS304 8.0Ømm bolt and flange nut. An appropriately rated Rail, by others, may be attached to the "L-Foot" per the Rail manufacturer's installation instructions. The installation of the RT Mini II must be with the long direction parallel to the roof framing, and in accordance with Roof Tech's Installation Manual. The system is attached to the wood substrate with SS304 5.0Ø mm x 60 mm long wood screws. **Two** (2) wood screws are required at the "Centered Rafter" installations with plywood, **Six** (6) wood screws are required at the "Centered Rafter" installations with OSB and **five** (5) wood screws are required at the "OSB only", "Plywood only" and "Off-Centered Rafter" installations.

## Connection Load Tests

Load tests conducted by IBT and WTI measured the failure capacity of the connection assembly with 4 different roof wood substrates. In these tests, failure occurred by pullout of the wood screws, attached component failure and failure of substrate.

Tests showed that critical failure occurs in one of four ways:

1. Pullout of wood screws from the 2x Rafter/OSB/Plywood.
2. Combined failure-Pull out of wood screws with upper channel separation allowing bolt head to slip out.
3. Partial failure of upper channel.
4. Failure of OSB.

In order to establish connection capacities, the lowest value of each failure mechanism for each wood substrate was multiplied by a material resistance factor of 0.55 for tension loads, 0.72 for shear loads and 0.81 for compression loads. The resistance factor was based on formulas presented in CAN/CSA-086-19 (Engineering Design in Wood) for similar proprietary wood connection products where the capacity is assessed through load testing. The material resistance factor of 0.6 for tension, 0.8 in shear and 0.9 in compression/bending is multiplied by a test reliability factor of 0.91 for a minimum of six tests. These values are shown in Table 1 below. The tests for rafter connections were conducted for D.Fir-L, which is not the commonly used lumber in Canada, thus values for rafter connections are adjusted for SPF lumber

Project Name:	RT-MINI II-BC (BCBC2018)	Date :	18/05/2021	Design:	SA
Project No.:	20027-T2	Description	Calculation of mount capacities	Checker:	MG

by reduction factor of 0.9 and 0.75 for shear and tension capacities, respectively. The factored connection resistance was compared to factored loads as per BCBC 2018.

Table 1: Factored test resistance of roof wood substrates

Serial No.	Substrate Material with 2 layers Asphalt Shingles	Factored test resistance =		
		Ø x (minimum test result) kN		
		Tension	Shear	Compression
1	15/32" plywood over centered 2x4 D.Fir-L #2 Rafter with (2)-60mm screws.	3.706 <sup>(1)</sup>	3.340 <sup>(2)</sup>	5.403
2	15/32" plywood over centered 2x4 D.Fir-L #2 Rafter with (2)-90mm screws.	3.633 <sup>(1)</sup>	4.166 <sup>(2)</sup>	5.403
3	7/16" OSB Sheathing over centered 2x4 D.Fir-L #2 Rafter with (6)-60mm screws.	4.354 <sup>(1)</sup>	3.981 <sup>(2)</sup>	5.403
4	7/16" OSB Sheathing over off-centered 2x4 D.Fir-L #2 Rafter with (5)-60mm screws	2.062 <sup>(1)</sup>	3.695 <sup>(2)</sup>	1.794
5	7/16" OSB Sheathing only with (5)-60 mm screws	0.673	1.588	1.794
6	15/32" Plywood only (5)-60 mm screws	0.812	1.755	3.236

Note:

- 1) Tension resistance adjusted for SPF#2 with reduction factor of 0.75 as per CSA-086-19 .
- 2) Shear resistance adjusted for SPF#2 with reduction factor of 0.9 as per CSA-086-19 .

The parameters and results of our review are summarized below. Refer to Exhibit A for details of the roof mount attachment and mount orientation diagrams.

## Connection Load Analysis

Codes:

- Design load and climatic data ranges as per British Columbia Building Code 2018 (BCBC 2018).
- Design codes as per Engineering Design in Wood (CSA 086-19) and Strength Design in Aluminum (CSA S157-05).

Institute of Building Technology:

- Report Number 2426-21007, Project Number 34578, Report Issued April 09, 2021, for Tensile and Shear capacities of RT Mini II on all the three wood substrates.

Project Name:	RT-MINI II-BC (BCBC2018)	Date :	18/05/2021	Design:	SA
Project No.:	20027-T2	Description	Calculation of mount capacities	Checker:	MG

#### Test Data from Western Technologies Inc.:

- Job No. 2163XD260:
  - Event no. G260-3, dated January 3, 2014: OSB only and OBS on Rafter, Compression.
  - Event no. G260-6, dated May 30, 2014: Plywood, Compression.

#### Design Loads and Parameters:

- Dead Loads: 0.19 kPa (4 psf) photovoltaic (PV) panel self-weight including assumed weight of rails.
- Wind Loads: 1 in 50 year wind pressure “q” per BCBC 2018 Climate Data. In determining the external wind pressure “p” acting statically and normal to the surface, the following factors have been used per Clause 4.1.7.3 of BCBC-2018:
  - $I_w$  = Importance factor for wind = 1.0 for the ULS loading cases;
  - q = Reference velocity pressure based on a probability of exceedance in any one year of 1 in 50, and which values are used in the Tables;
  - $C_e$  = Exposure factor = 1.0 for Open terrain and 0.7 for Rough terrain;
  - $C_t$  = Topographic factor = 1.0, assuming that the building is not located on a hill or escarpment with a slope greater than 10%;
  - $C_g C_p$  = Values based on Figure 4.1.7.6.-C and 4.1.7.6.-E of BCBC-2018
  - $p = I_w \cdot q \cdot C_e \cdot C_t \cdot C_g \cdot C_p$ , where p is as mentioned above.
  - If any of the above factors are different for a particular situation, the Tables can still be used by appropriately modifying wind load and using the corresponding value of the “q” listed. Such modification must be done by a person familiar with the requirements of BCBC-2018.
- Snow and Rain Loads: 1 in 50 year combined snow and rain load calculated per BCBC-2018. In order to use the Tables, the total snow and rain loads have to be calculated by a person familiar with the requirements of BCBC-2018 based on the formulae mentioned in the Tables. Importance factor  $I_s = 1.0$  for the ULS loading cases.
- Live Loads: No live load on top of PV cells.
- Seismic Loads: excluded; does not govern by inspection.

#### Materials and Geometry:

- Roof rafters to be SPF No. 2 spaced at 24” on centre maximum.
- OSB to be minimum 7/16” (11.1 mm) thick, CSA O437 O1 grade with panel edges supported.
- Plywood to be minimum 15/32” (11.9 mm) thick, tongue and groove, Douglas Fir conforming to CSA O121 with panel edges supported.
- Solar panels to be compliant with UL 1703.
- A range of slopes were considered for the roof loads. A conversion table between slopes and angles is provided below for reference.

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

## **Table 2: Roof Slope to Roof Angle Conversion**

Roof Slope (m/m)	0 : 12	1 : 12	2 : 12	3 : 12	4 : 12	5 : 12	6 : 12	7 : 12	8 : 12	9 : 12	10 : 12	11 : 12	12 : 12
Roof angle (deg)	0.0	4.8	9.5	14.0	18.4	22.6	26.6	30.3	33.7	36.9	39.8	42.5	45.0

## **Wind Roof Zones**

The following notation is used in the report in line with BCBC-2018 Clause 4.1.7.5. 4 c). Refer to figure 4.1.7.6-C and Figure 4.1.7.6-E in BCBC-2018 for location of following zones :

- R = roof in general, except as follows:
- S = within a distance distance equal to the larger of 0.1D and 0.1W from the roof edge,
- C = within a distance equal to the larger of 0.2W and 0.2D from the roof corner,  
*where D and W are the widths of the building.*

## **Results**

The tables in the following pages summarize the maximum spacing of RT Mini II clamps for 1 in 50 year snow and wind loads for each roof wood substrate. The installation contractor is responsible for verifying the strength of the roof framing, the structural strength of the PV panels and the capacities of all materials supplied by others as a pre-condition for determining the suitability of use of these tables.

An individual who is competent and familiar with BCBC 2018 will be required for the use of the tables, prior to installation of the roof connections.

## **Table 3: Metres to feet conversion**

Metres	0.00	0.30	0.61	0.91	1.22	1.52	1.83	2.13	2.44	2.74	3.05
Feet	0	1	2	3	4	5	6	7	8	9	10

Project Name:	RT-MINI II-BC (BCBC2018)	Date :	18/05/2021	Design:	SA
Project No.:	20027-T2	Description	Calculation of mount capacities	Checker:	MG

### Provincial Range Of Environmental Loads

Province		Ss kPa	Sr kPa	q (1/50) kPa
British Columbia	MIN	0.9	0.10	0.30
	MAX	9.5	0.90	0.78

### Table Notes for Tables RT1 to RT18

The tabulated values are based on the following criteria in addition to the notes above:

1. Building mean roof height = 10m (30 ft) maximum.
2. Importance factor 1.0.
3. Tables are based on solar panel maximum tributary widths of:
  - a. Landscape tables: 1.02 m (40 in)
  - b. Portrait 60 Cell tables: 1.73 m (68 in)
  - c. Portrait 72 Cell tables: 1.97 m (77.5 in)

If larger tributary widths are being examined the maximum spacings shown in tables must be proportionally reduced. As an example, for a table based on a tributary width of 1.02 m (40 in) and the maximum spacing is given as 2.44 m (96 in), if a larger tributary width of 1.12 m (44 in) is desired, the maximum mount spacing is to be proportionally reduced as  $1.02/1.12 \times 2.44 = 2.22$  m spacing (87.3 in).

4. Solar panel & rail dead load = approximately 0.19 kPa (4.0 psf).
5. OSB shall be 24/16 APA rated sheathing minimum (7/16" thick).
6. Plywood shall be 32/16 APA rated sheathing minimum (15/32" thick).
7. Sheathing shall be free of defects including, but not limited to water damage and delamination.
8. Roof rafters or trusses spaced at 0.61m (24") on centre maximum.
9. The maximum rail cantilever shall be the lesser of 40% of the maximum rail span/ spacing in the Tables below, and the maximum recommended by the rail manufacturer. Provide thermal expansion splices at spacing not exceeding 4.25 metres (14 feet) per rail manufacturer's instructions.
10. PV panels must be supported per the PV manufacturer's required orientation, location and/or spacing. Loads shall be limited to the recommended values of PV manufacturer.
11. The mounts are attached through a maximum of 2 layers of composite asphalt roof shingles. Tables not valid on concrete roof tile.
12. Maximum height from bottom of base mount to top of rail shall not exceed 125mm (5") for the OSB & Plywood only installation options and 175mm (7") for the rafter installation option. Ref. Exhibit 'A' Detail 3.
13. The capacities of the mounts have been checked for shear, compression, and interaction of shear and tension, and the sum of the (factored actual/ factored allowable) is < 1.0.
14. The blanks in the tables are inadmissible loading for the particular mount in that location and loads.

---

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021

Design: SA

---

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

---

## ***RT-E-Mount Mini II - TABLES***



Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021

Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT1: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-60 mm screws - 60 Cells PV Panels - Portrait Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
<b>0.50</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219	1.219		
			S	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914	0.610		
			C	2.134	1.524	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305		
		7 TO 27	R	2.438	2.438	2.438	1.829	1.524	1.219	1.219	1.219	0.914	0.914	0.610	
			S	2.438	2.134	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
			C	2.438	1.524	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305		
		28 TO 45	R	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	1.219	0.914	
			S	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	1.219	0.914	0.914	
			C	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914		
	<b>1.00</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219	1.219	
				S	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914	0.610	
				C	2.134	1.524	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305	
			7 TO 27	R	2.438	2.438	2.438	1.829	1.524	1.219	1.219	1.219	0.914	0.914	0.610
				S	2.438	2.134	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305
				C	2.438	1.524	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	
			28 TO 45	R	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	1.219	0.914
				S	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	1.219	0.914	0.914
				C	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914	
<b>1.50</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219	1.219	
				S	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914	0.610	
				C	2.134	1.524	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305	
			7 TO 27	R	2.438	2.438	2.438	1.829	1.524	1.219	1.219	1.219	0.914	0.914	0.610
				S	2.438	2.134	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305
				C	2.438	1.524	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	
			28 TO 45	R	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.219	1.219	0.914
				S	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.219	1.219	0.914	0.914
				C	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.219	1.219	0.914	0.914
	ROUGH	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	
			S	2.438	2.438	2.438	2.438	2.438	2.438	1.829	1.524	1.524	1.219	1.219	
			C	2.438	2.134	1.524	1.219	0.914	0.610	0.610	0.610	0.610	0.305	0.305	
		7 TO 27	R	2.438	2.438	2.438	2.438	2.438	2.438	1.829	1.524	1.524	1.219	1.219	
			S	2.438	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.914	0.610	0.610	
			C	2.438	2.438	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610		
		28 TO 45	R	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	
			S	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	
			C	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT1: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-60 mm screws - 60 Cells PV Panels - Portrait Orientation																	
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																	
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																	
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa													
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10				
<b>2.00</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.524	1.219	1.219			
			S	1.829	1.829	1.829	1.829	1.524	1.219	1.219	0.914	0.914	0.610	0.610			
			C	1.829	1.524	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305				
		7 TO 27	R	2.134	2.134	2.134	1.829	1.524	1.219	1.219	0.914	0.914	0.610	0.610			
			S	2.134	2.134	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305			
			C	2.134	1.524	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305				
		28 TO 45	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914		
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914		
			C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914		
		<b>2.50</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	
					S	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	0.610	0.610	
					C	1.524	1.524	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305		
	7 TO 27			R	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	0.610	0.610		
				S	1.524	1.524	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305		
				C	1.524	1.524	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305			
	28 TO 45			R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	
				S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	
				C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	
	<b>3.00</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219
						S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610
						C	1.219	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305	
			7 TO 27		R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610
					S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.610	0.305
					C	1.219	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305		
28 TO 45			R		0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S		0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C		0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
ROUGH			0 TO 6		R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
					S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
					C	1.219	1.219	1.219	1.219	0.914	0.610	0.610	0.610	0.610	0.305		
			7 TO 27	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
				S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
				C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914			
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914			
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914				





Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT1: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-60 mm screws - 60 Cells PV Panels - Portrait Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>6.50</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	<b>7.00</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
			28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
ROUGH		0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
<b>7.50</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT1: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-60 mm screws - 60 Cells PV Panels - Portrait Orientation																		
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																		
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																		
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa														
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10					
<b>8.00</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305				
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		<b>8.50</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.10 Cb = 0.18 Cw = 1.10 Ca = 1.10 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	7 TO 27			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	28 TO 45			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	<b>9.00</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.10 Cb = 0.18 Cw = 1.10 Ca = 1.10 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
						S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
						C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			7 TO 27		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
28 TO 45			R		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
ROUGH			0 TO 6		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT1: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-60 mm screws - 60 Cells PV Panels - Portrait Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE $\alpha$ (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
9.50	OPEN	0 TO 6		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		7 TO 27		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		28 TO 45		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	ROUGH	0 TO 6		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		7 TO 27		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		28 TO 45		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
10.00	OPEN	0 TO 6		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		7 TO 27		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		28 TO 45		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	ROUGH	0 TO 6		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		7 TO 27		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		28 TO 45		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT2: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-90 mm screws - 60Cells PV Panels - Portrait Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>0.50</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables Suggested values Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914			
			S	2.438	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.914	0.610			
			C	2.134	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305			
		7 TO 27	R	2.438	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.914	0.914	0.610		
			S	2.438	2.134	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.305		
			C	2.438	1.524	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305			
		28 TO 45	R	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	1.219	0.914		
			S	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914	0.914		
			C	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914			
		<b>1.00</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables Suggested values Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	
					S	2.438	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.914	0.610	
					C	2.134	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305	
	7 TO 27			R	2.438	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.914	0.914	0.610	
				S	2.438	2.134	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.305		
				C	2.438	1.524	0.914	0.914	0.610	0.610	0.305	0.305	0.305			
	28 TO 45			R	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	1.219	0.914	
				S	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914	0.914	
				C	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914		
	<b>1.50</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables Suggested values Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914
						S	2.438	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.914	0.610
						C	2.134	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305
			7 TO 27		R	2.438	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.914	0.914	0.610
					S	2.438	2.134	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.305	
					C	2.438	1.524	0.914	0.914	0.610	0.610	0.305	0.305	0.305		
28 TO 45			R		2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	1.219	0.914	
			S		2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914	0.914	
			C		2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914		
ROUGH			0 TO 6		R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524
					S	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219	1.219	
					C	2.438	2.134	1.524	1.219	0.914	0.610	0.610	0.610	0.610	0.305	
			7 TO 27	R	2.438	2.438	2.438	2.438	2.438	1.829	1.524	1.524	1.219	1.219		
				S	2.438	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.914	0.610		
				C	2.438	2.134	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.305		
		28 TO 45	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524		
			S	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219			
			C	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219			



Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT2: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-90 mm screws - 60Cells PV Panels - Portrait Orientation																	
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																	
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																	
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa													
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10				
<b>2.00</b> $S = I_s(S_e C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.219	1.219	0.914				
			S	1.829	1.829	1.829	1.829	1.524	1.219	0.914	0.914	0.914	0.305	0.610			
			C	1.829	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305			
		7 TO 27	R	2.134	2.134	2.134	1.829	1.524	1.219	0.914	0.914	0.914	0.610	0.610			
			S	2.134	2.134	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305			
			C	2.134	1.524	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305			
		28 TO 45	R	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.219	1.219	0.914	0.914			
			S	1.829	1.829	1.829	1.829	1.829	1.524	1.219	1.219	0.914	0.914	0.914			
			C	1.829	1.829	1.829	1.829	1.524	1.219	1.219	0.914	0.914	0.914	0.914			
		<b>2.50</b> $S = I_s(S_e C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914		
					S	1.524	1.524	1.524	1.524	1.219	0.914	0.914	0.914	0.914	0.610	0.305	
					C	1.524	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
	7 TO 27			R	1.524	1.524	1.524	1.524	1.524	1.219	0.914	0.914	0.914	0.610	0.610		
				S	1.524	1.524	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305		
				C	1.524	1.524	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305		
	28 TO 45			R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914		
				S	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	1.219	0.914	0.914		
				C	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	1.219	0.914	0.914		
	<b>3.00</b> $S = I_s(S_e C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	
						S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.914	0.610
						C	1.219	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305
			7 TO 27		R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.914	0.610	
					S	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.305	
					C	1.219	1.219	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
28 TO 45			R		1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914		
			S		1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914		
			C		1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914		
ROUGH			0 TO 6		R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
					S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
					C	1.219	1.219	1.219	1.219	0.914	0.610	0.610	0.610	0.610	0.305	0.305	
			7 TO 27	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
				S	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.914	0.610	0.610		
				C	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305		
		28 TO 45	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219			
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219			
			C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219			

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT2: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-90 mm screws - 60Cells PV Panels - Portrait Orientation																	
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																	
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																	
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa													
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10				
<b>3.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables Suggested values Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914			
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610			
			C	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305			
		7 TO 27	R	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.914	0.914	0.610			
			S	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.305			
			C	1.219	1.219	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305			
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914			
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914			
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914			
		<b>4.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables Suggested values Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
					S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	
					C	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
	7 TO 27			R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610		
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305		
				C	0.914	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305		
	28 TO 45			R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
				C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
	<b>4.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables Suggested values Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
						S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
						C	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305
			7 TO 27		R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	
					S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	
					C	0.914	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
28 TO 45			R		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
ROUGH			0 TO 6		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
					S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
					C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305		
			7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610		
				C	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	0.305		
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT2: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-90 mm screws - 60Cells PV Panels - Portrait Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>5.00</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
	ROUGH	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
<b>5.50</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
	ROUGH	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
<b>6.00</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
	ROUGH	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT2: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-90 mm screws - 60Cells PV Panels - Portrait Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>6.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305		
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
	<b>7.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305
			28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
<b>7.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305
			28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT2: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-90 mm screws - 60Cells PV Panels - Portrait Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>8.00</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	7 TO 27	R			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		S			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		C			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	28 TO 45	R		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		S		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		C		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		<b>8.50</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.10 Cb = 0.18 Cw = 1.10 Ca = 1.10 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
						S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
						C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	7 TO 27		R			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
28 TO 45	R		0.305		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
	S		0.305		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
	C		0.305		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
	ROUGH		0 TO 6		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
7 TO 27				R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
28 TO 45			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			<b>9.00</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.10 Cb = 0.18 Cw = 1.10 Ca = 1.10 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
						S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
						C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
7 TO 27	R					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	S					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	C					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
28 TO 45	R	0.305			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
	S	0.305			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
	C	0.305			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
	ROUGH	0 TO 6			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
7 TO 27				R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
28 TO 45		R		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		S		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		C		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT2: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-90 mm screws - 60Cells PV Panels - Portrait Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE $\alpha$ (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
9.50	OPEN	0 TO 6		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		7 TO 27		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		28 TO 45		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	ROUGH	0 TO 6		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		7 TO 27		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		28 TO 45		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
10.00	OPEN	0 TO 6		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		7 TO 27		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		28 TO 45		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	ROUGH	0 TO 6		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		7 TO 27		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		28 TO 45		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT3: RT-E-Mount Mini II - Rafter centered with 7/16 OSB and (6)-60 mm screws - 60Cells PV Panels - Portrait Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>0.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219			
			S	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914			
			C	2.438	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305				
		7 TO 27	R	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914			
			S	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610			
			C	2.438	1.829	1.219	0.914	0.610	0.610	0.305	0.305	0.305				
		28 TO 45	R	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219			
			S	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914			
			C	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914			
		<b>1.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219	
					S	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914	
					C	2.438	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305		
	7 TO 27			R	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914		
				S	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610		
				C	2.438	1.829	1.219	0.914	0.610	0.610	0.305	0.305	0.305			
	28 TO 45			R	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219		
				S	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914		
				C	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914		
	<b>1.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219
						S	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914
						C	2.438	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	
			7 TO 27		R	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914	
					S	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610	
					C	2.438	1.829	1.219	0.914	0.610	0.610	0.305	0.305	0.305		
28 TO 45			R		2.134	2.134	2.134	2.134	2.134	2.134	1.829	1.524	1.524	1.219		
			S		2.134	2.134	2.134	2.134	2.134	1.829	1.524	1.219	1.219	0.914		
			C		2.134	2.134	2.134	2.134	2.134	1.829	1.524	1.219	1.219	0.914		
ROUGH			0 TO 6		R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	2.134	
					S	2.438	2.438	2.438	2.438	2.438	2.438	1.829	1.829	1.524	1.219	
					C	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610	
			7 TO 27	R	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219		
				S	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914		
				C	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610		
		28 TO 45	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829			
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829			
			C	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829			

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT3: RT-E-Mount Mini II - Rafter centered with 7/16 OSB and (6)-60 mm screws - 60Cells PV Panels - Portrait Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
<b>2.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.524	1.219	
			S	1.829	1.829	1.829	1.829	1.829	1.524	1.219	1.219	1.219	0.914	0.914	
			C	1.829	1.524	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305		
		7 TO 27	R	2.134	2.134	2.134	2.134	1.829	1.524	1.219	1.219	1.219	0.914	0.914	
			S	2.134	2.134	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610	
			C	2.134	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305		
		28 TO 45	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	
			S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	1.219	0.914	
			C	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	
	<b>2.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	
				S	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	
				C	1.524	1.524	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305	
			7 TO 27	R	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	1.219	0.914	0.914
				S	1.524	1.524	1.524	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610
				C	1.524	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
			28 TO 45	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219
				S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914
				C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914
<b>3.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
				S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914
				C	1.219	1.219	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305	
			7 TO 27	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914
				S	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610
				C	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
			28 TO 45	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219
				S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914
				C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914
	ROUGH	0 TO 6	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
			C	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610		
		7 TO 27	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	
			C	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610		
		28 TO 45	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
			C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	



Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT3: RT-E-Mount Mini II - Rafter centered with 7/16 OSB and (6)-60 mm screws - 60Cells PV Panels - Portrait Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
<b>3.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	0.305		
		7 TO 27	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	
			S	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	
			C	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305		
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
	<b>4.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
				C	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	0.305	
			7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610
				C	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
			28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
				C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
<b>4.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305
			7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610
				C	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
			28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
	ROUGH	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
		7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT3: RT-E-Mount Mini II - Rafter centered with 7/16 OSB and (6)-60 mm screws - 60Cells PV Panels - Portrait Orientation

MAXIMUM SPACING OF RT-E MOUNT MINI (m)

SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY

SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>5.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305			
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305			
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
		ROUGH	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
	7 TO 27		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
	28 TO 45		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
	<b>5.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
					S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
					C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305
		7 TO 27		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	
28 TO 45		R		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
		S		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
		C		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
ROUGH		0 TO 6		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
		<b>6.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
					S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
					C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305
7 TO 27				R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	
28 TO 45	R			0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
	S			0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
	C			0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
ROUGH	0 TO 6			R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
	7 TO 27		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
	28 TO 45		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT3: RT-E-Mount Mini II - Rafter centered with 7/16 OSB and (6)-60 mm screws - 60Cells PV Panels - Portrait Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>6.50</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305		
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305		
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		<b>7.00</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	7 TO 27			R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	
	28 TO 45			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	ROUGH			0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
28 TO 45			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
<b>7.50</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	7 TO 27			R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	
	28 TO 45	R		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		S		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		C		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	ROUGH	0 TO 6		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT3: RT-E-Mount Mini II - Rafter centered with 7/16 OSB and (6)-60 mm screws - 60Cells PV Panels - Portrait Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>8.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	7 TO 27		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	28 TO 45		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	<b>8.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.10 Cb = 0.18 Cw = 1.10 Ca = 1.10 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		7 TO 27		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
28 TO 45		R		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		S		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		C		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
ROUGH		0 TO 6		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		<b>9.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.10 Cb = 0.18 Cw = 1.10 Ca = 1.10 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
7 TO 27				R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
28 TO 45	R			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	S			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	C			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
ROUGH	0 TO 6			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	7 TO 27		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	28 TO 45		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT3: RT-E-Mount Mini II - Rafter centered with 7/16 OSB and (6)-60 mm screws - 60Cells PV Panels - Portrait Orientation													
MAXIMUM SPACING OF RT-E MOUNT MINI (m)													
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY													
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE $\alpha$ (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa									
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10
9.50	OPEN	0 TO 6		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		7 TO 27		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	28 TO 45		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	ROUGH	0 TO 6		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
7 TO 27			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
28 TO 45		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
10.00	OPEN	0 TO 6		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		7 TO 27		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	28 TO 45		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	ROUGH	0 TO 6		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
7 TO 27			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
28 TO 45		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT4: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-60 mm screws - 72 Cells PV Panels - Portrait Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>0.50</b> S = Is(Ss <sup>2</sup> Cb <sup>2</sup> Cw <sup>2</sup> Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	1.829	1.524	1.524	1.219	0.914	0.914	
			S	2.438	2.438	2.134	1.524	1.219	1.219	0.914	0.914	0.610	0.610	
			C	1.829	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
		7 TO 27	R	2.438	2.438	2.134	1.524	1.219	1.219	0.914	0.914	0.610	0.610	
			S	2.438	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
			C	2.134	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
		28 TO 45	R	2.438	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914	
			S	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914	0.610	
			C	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914	0.610	
	<b>1.00</b> S = Is(Ss <sup>2</sup> Cb <sup>2</sup> Cw <sup>2</sup> Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	1.829	1.524	1.524	1.219	0.914	0.914
				S	2.438	2.438	2.134	1.524	1.219	1.219	0.914	0.914	0.610	0.610
				C	1.829	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305
			7 TO 27	R	2.438	2.438	2.134	1.524	1.219	1.219	0.914	0.914	0.610	0.610
				S	2.438	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305
				C	2.134	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	
			28 TO 45	R	2.438	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914
				S	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914	0.610
				C	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914	0.610
ROUGH		0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	
			S	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	
			C	2.438	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
		7 TO 27	R	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	
			S	2.438	2.438	2.134	1.524	1.219	0.914	0.914	0.914	0.610	0.610	
			C	2.438	2.134	1.524	1.219	0.914	0.610	0.610	0.610	0.305	0.305	
		28 TO 45	R	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	
			S	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	
			C	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	
<b>1.50</b> S = Is(Ss <sup>2</sup> Cb <sup>2</sup> Cw <sup>2</sup> Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.134	2.134	2.134	2.134	1.829	1.524	1.524	1.219	0.914	0.914	
			S	2.134	2.134	2.134	1.524	1.219	1.219	0.914	0.914	0.610	0.610	
			C	1.829	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
		7 TO 27	R	2.438	2.438	2.134	1.524	1.219	1.219	0.914	0.914	0.610	0.610	
			S	2.438	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
			C	2.134	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
		28 TO 45	R	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	
			S	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	0.610	
			C	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	0.610	
	ROUGH	0 TO 6	R	2.134	2.134	2.134	2.134	2.134	2.134	2.134	1.829	1.524	1.524	
			S	2.134	2.134	2.134	2.134	2.134	1.829	1.524	1.219	1.219	0.914	
			C	2.134	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
		7 TO 27	R	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	
			S	2.438	2.438	2.134	1.524	1.219	0.914	0.914	0.914	0.610	0.610	
			C	2.438	2.134	1.524	1.219	0.914	0.610	0.610	0.610	0.305	0.305	
		28 TO 45	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	
			S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	
			C	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT4: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-60 mm screws - 72 Cells PV Panels - Portrait Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>2.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	0.914	0.914			
			S	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	0.610	0.610			
			C	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305			
		7 TO 27	R	1.829	1.829	1.829	1.524	1.219	1.219	0.914	0.914	0.610	0.610			
			S	1.829	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305			
			C	1.829	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305			
		28 TO 45	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914		
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610		
			C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610		
		<b>2.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	
					S	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	
					C	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
	7 TO 27			R	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	0.610	0.610		
				S	1.524	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305		
				C	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305		
	28 TO 45			R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	
				C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	
	<b>3.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610
						S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610
						C	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305
			7 TO 27		R	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	
					S	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
					C	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
28 TO 45			R		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
ROUGH			0 TO 6		R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
					S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
					C	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
			7 TO 27	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	
				S	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.914	0.610	0.610	
				C	1.219	1.219	1.219	1.219	1.219	0.914	0.610	0.610	0.610	0.305	0.305	
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT4: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-60 mm screws - 72 Cells PV Panels - Portrait Orientation																	
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																	
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																	
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa													
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10				
<b>3.50</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914				
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610			
			C	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305			
		7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610			
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305			
			C	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305			
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
		<b>4.00</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
					S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
					C	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	
	7 TO 27			R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610		
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305		
				C	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305		
	28 TO 45			R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
	<b>4.50</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
						S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
						C	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305
			7 TO 27		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
					S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	
					C	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	
28 TO 45			R		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
ROUGH			0 TO 6		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
					S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
					C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305		
			7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610		
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610		
				C	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	0.305		
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			



Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT4: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-60 mm screws - 72 Cells PV Panels - Portrait Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
<b>5.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305		
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	<b>5.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				C	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
			7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305
			28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
<b>6.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305
			28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	ROUGH	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305		
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT4: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-60 mm screws - 72 Cells PV Panels - Portrait Orientation																	
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																	
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																	
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa													
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10				
<b>6.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305				
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305			
			C	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305			
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		<b>7.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	7 TO 27			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	28 TO 45			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	<b>7.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70			OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
						S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
						C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			7 TO 27		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
28 TO 45			R		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
ROUGH			0 TO 6		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT4: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-60 mm screws - 72 Cells PV Panels - Portrait Orientation																		
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																		
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																		
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa														
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10					
<b>8.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305				
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		<b>8.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	7 TO 27			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	28 TO 45			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	<b>9.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70			OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
						S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
						C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			7 TO 27		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
28 TO 45			R		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
ROUGH			0 TO 6		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT4: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-60 mm screws - 72 Cells PV Panels - Portrait Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE $\alpha$ (deg.)	ROOF ZONE	BASIC WIND PRESSURE $q$ (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>9.50</b> $S = I_s(S_e C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for $\alpha \leq 30$ deg C <sub>s</sub> = (70 - $\alpha$ )/40 for 30 deg < $\alpha$ < 70	OPEN	0 TO 6		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		7 TO 27		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	ROUGH	0 TO 6		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		7 TO 27		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
10.00	OPEN	0 TO 6		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		7 TO 27		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
ROUGH	0 TO 6		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	7 TO 27		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT5: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-90 mm screws - 72 Cells PV Panels - Portrait Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>0.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914			
			S	2.438	2.438	2.134	1.524	1.219	0.914	0.914	0.610	0.610	0.610			
			C	1.829	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305			
		7 TO 27	R	2.438	2.438	2.134	1.524	1.219	1.219	0.914	0.914	0.610	0.610			
			S	2.438	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305			
			C	2.134	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305			
		28 TO 45	R	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914			
			S	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914	0.610			
			C	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914	0.610			
		<b>1.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914	
					S	2.438	2.438	2.134	1.524	1.219	0.914	0.914	0.610	0.610		
					C	1.829	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
	7 TO 27			R	2.438	2.438	2.134	1.524	1.219	1.219	0.914	0.914	0.610	0.610		
				S	2.438	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305		
				C	2.134	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305		
	28 TO 45			R	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914		
				S	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914	0.610		
				C	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914	0.610		
	<b>1.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	2.134	2.134	2.134	2.134	1.829	1.524	1.219	1.219	0.914	0.914
						S	2.134	2.134	2.134	1.524	1.219	0.914	0.914	0.610	0.610	
						C	1.829	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305
			7 TO 27		R	2.438	2.438	2.134	1.524	1.219	1.219	0.914	0.914	0.610	0.610	
					S	2.438	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
					C	2.134	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
28 TO 45			R		2.134	2.134	2.134	2.134	1.829	1.524	1.219	1.219	0.914	0.914		
			S		2.134	2.134	2.134	1.829	1.524	1.219	1.219	0.914	0.914	0.610		
			C		2.134	2.134	2.134	1.829	1.524	1.219	1.219	0.914	0.914	0.610		
ROUGH			0 TO 6		R	2.134	2.134	2.134	2.134	2.134	2.134	2.134	1.829	1.524	1.219	1.219
					S	2.134	2.134	2.134	2.134	1.829	1.524	1.524	1.219	0.914	0.914	
					C	2.134	1.829	1.219	0.914	0.914	0.610	0.610	0.305	0.305	0.305	
			7 TO 27	R	2.438	2.438	2.438	2.438	2.134	1.524	1.524	1.219	1.219	0.914		
				S	2.438	2.438	2.134	1.524	1.219	0.914	0.914	0.914	0.610	0.610		
				C	2.438	1.829	1.524	0.914	0.914	0.610	0.610	0.610	0.305	0.305		
		28 TO 45	R	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	1.829	1.524	1.219		
			S	2.134	2.134	2.134	2.134	1.829	1.524	1.524	1.219	1.219	0.914			
			C	2.134	2.134	2.134	1.829	1.524	1.219	1.219	0.914	0.914	0.610			

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT5: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-90 mm screws - 72 Cells PV Panels - Portrait Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>2.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	
			S	1.524	1.524	1.524	1.524	1.219	0.914	0.914	0.914	0.610	0.610	
			C	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
		7 TO 27	R	1.829	1.829	1.829	1.524	1.219	1.219	0.914	0.914	0.610	0.610	
			S	1.829	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
			C	1.829	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
		28 TO 45	R	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	
			S	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	0.610	
			C	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	0.610	
	ROUGH	0 TO 6	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	0.914	0.914
			S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	0.914	0.914	
			C	1.524	1.524	1.219	0.914	0.914	0.610	0.610	0.305	0.305	0.305	
		7 TO 27	R	1.829	1.829	1.829	1.829	1.829	1.524	1.524	1.219	1.219	0.914	
			S	1.829	1.829	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.305	
			C	1.829	1.829	1.524	0.914	0.914	0.610	0.610	0.305	0.305	0.305	
		28 TO 45	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219
			S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219
			C	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219
<b>2.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	
			S	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.914	0.610	0.610	
			C	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
		7 TO 27	R	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	0.610	0.610	
			S	1.524	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
			C	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
		28 TO 45	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610
			C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610
	ROUGH	0 TO 6	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914
			C	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.305	0.305	0.305	
		7 TO 27	R	1.524	1.524	1.524	1.524	1.524	1.219	0.914	0.914	1.219	1.219	0.914
			S	1.524	1.524	1.524	1.524	1.219	0.914	0.914	0.610	0.610	0.305	0.305
			C	1.524	1.524	1.524	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
		28 TO 45	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219
			C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219
<b>3.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610
			C	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
		7 TO 27	R	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	
			S	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
			C	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610
	ROUGH	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
			C	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	
		7 TO 27	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610
			S	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.305	0.305
			C	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT5: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-90 mm screws - 72 Cells PV Panels - Portrait Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>3.50</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	
			C	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305	
			C	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	
	<b>4.00</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305
			7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305
				C	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
<b>4.50</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305
			7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305
			28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
	ROUGH	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	
		7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305	
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	





Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT5: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-90 mm screws - 72 Cells PV Panels - Portrait Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>6.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	<b>7.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
<b>7.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70		OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT5: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-90 mm screws - 72 Cells PV Panels - Portrait Orientation

MAXIMUM SPACING OF RT-E MOUNT MINI (m)

SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY

SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa															
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10						
<b>8.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305				
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		<b>8.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	7 TO 27			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	28 TO 45			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	<b>9.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70			OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
						S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
						C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			7 TO 27		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
28 TO 45			R		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
ROUGH			0 TO 6		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT5: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-90 mm screws - 72 Cells PV Panels - Portrait Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>9.50</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			7 TO 27		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			28 TO 45		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	<b>10.00</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
						0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
						0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				7 TO 27		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
						0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
						0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				28 TO 45		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
						0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
						0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
ROUGH		0 TO 6		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			7 TO 27		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			28 TO 45		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT6: RT-E-Mount Mini II - Rafter centered with 7/16 OSB and (6)-60 mm screws - 72 Cells PV Panels - Portrait Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>0.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	1.829	1.524	1.524	1.219	1.219			
			S	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914	0.610			
			C	2.438	1.524	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305			
		7 TO 27	R	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914	0.914			
			S	2.438	2.438	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610			
			C	2.438	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305			
		28 TO 45	R	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219	1.219			
			S	2.438	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914			
			C	2.438	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914			
		<b>1.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	1.829	1.524	1.524	1.219	1.219	
					S	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914	0.610	
					C	2.438	1.524	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	
	7 TO 27			R	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914	0.914		
				S	2.438	2.438	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610		
				C	2.438	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305		
	28 TO 45			R	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219	1.219		
				S	2.438	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914		
				C	2.438	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914		
	<b>1.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	2.134	2.134	2.134	2.134	2.134	1.829	1.524	1.524	1.219	1.219
						S	2.134	2.134	2.134	1.829	1.524	1.219	1.219	0.914	0.914	0.610
						C	2.134	1.524	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305
			7 TO 27		R	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914	0.914	
					S	2.438	2.438	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610	
					C	2.438	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	
28 TO 45			R		1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.524	1.219	1.219		
			S		1.829	1.829	1.829	1.829	1.829	1.524	1.219	1.219	0.914	0.914		
			C		1.829	1.829	1.829	1.829	1.829	1.524	1.219	1.219	0.914	0.914		
ROUGH			0 TO 6		R	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	1.829	1.829	
					S	2.134	2.134	2.134	2.134	2.134	2.134	1.829	1.524	1.219	1.219	
					C	2.134	2.134	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.305	
			7 TO 27	R	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219		
				S	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914	0.610		
				C	2.438	2.438	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.610		
		28 TO 45	R	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.524		
			S	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.524		
			C	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.524		

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT6: RT-E-Mount Mini II - Rafter centered with 7/16 OSB and (6)-60 mm screws - 72 Cells PV Panels - Portrait Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>2.00</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	
			S	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	0.610
			C	1.524	1.524	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	
		7 TO 27	R	1.829	1.829	1.829	1.829	1.524	1.219	1.219	0.914	0.914	0.914	
			S	1.829	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610	
			C	1.829	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305		
		28 TO 45	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	
			S	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	
			C	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914		
	<b>2.50</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
				S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610
				C	1.219	1.219	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305
			7 TO 27	R	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	0.914
				S	1.524	1.524	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610
				C	1.524	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305
			28 TO 45	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219
				S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914
				C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914
<b>3.00</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610
				C	0.914	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305
			7 TO 27	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.914
				S	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610
				C	1.219	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305
			28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
				C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
	ROUGH	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
		7 TO 27	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610	
			C	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610	
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT6: RT-E-Mount Mini II - Rafter centered with 7/16 OSB and (6)-60 mm screws - 72 Cells PV Panels - Portrait Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
<b>3.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	
			C	0.914	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
		7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	
			C	0.914	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
	<b>4.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305
			7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610
				C	0.914	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305
			28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
<b>4.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305
			7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
			28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
	ROUGH	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	
		7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	



Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT6: RT-E-Mount Mini II - Rafter centered with 7/16 OSB and (6)-60 mm screws - 72 Cells PV Panels - Portrait Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>6.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables Suggested values Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	<b>7.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables Suggested values Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
ROUGH		0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
<b>7.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables Suggested values Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	



Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT6: RT-E-Mount Mini II - Rafter centered with 7/16 OSB and (6)-60 mm screws - 72 Cells PV Panels - Portrait Orientation																		
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																		
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																		
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa														
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10					
<b>8.00</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305				
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		<b>8.50</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	7 TO 27			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	28 TO 45			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	<b>9.00</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70			OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
						S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
						C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			7 TO 27		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
28 TO 45			R		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
ROUGH			0 TO 6		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table RT6: RT-E-Mount Mini II - Rafter centered with 7/16 OSB and (6)-60 mm screws - 72 Cells PV Panels - Portrait Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
<b>9.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			7 TO 27		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			28 TO 45		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	<b>10.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
						0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
						0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				7 TO 27		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
						0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
						0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				28 TO 45		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
						0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
						0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
ROUGH		0 TO 6		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			7 TO 27		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			28 TO 45		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
					0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT7: RT-E-Mount Mini II - Rafter off-centered with 7/16 OSB and (5)-60 mm screws - 60 Cells PV Panels - Portrait Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>0.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.829	1.829	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610			
			S	1.829	1.829	1.219	0.914	0.914	0.610	0.610	0.305	0.305	0.305			
			C	1.219	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-			
		7 TO 27	R	2.134	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305		
			S	1.829	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305		
			C	1.219	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-			
		28 TO 45	R	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610		
			S	2.438	2.134	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305		
			C	2.438	2.134	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305		
		<b>1.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	
					S	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	
					C	0.914	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	
	7 TO 27			R	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305	
				S	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	
				C	1.219	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-		
	28 TO 45			R	1.524	1.524	1.524	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610	
				S	1.524	1.524	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
				C	1.524	1.524	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
	<b>1.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
						S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305
						C	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-
			7 TO 27		R	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305
					S	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305
					C	0.914	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-	
28 TO 45			R		0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	
			S		0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
			C		0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
ROUGH			0 TO 6		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
					S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
					C	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	
			7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	
				S	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	0.305	
				C	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610		
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610		

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT7: RT-E-Mount Mini II - Rafter off-centered with 7/16 OSB and (5)-60 mm screws - 60 Cells PV Panels - Portrait Orientation																	
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																	
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																	
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE $\alpha$ (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa													
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10				
<b>2.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for $\alpha \leq 30$ deg Cs = (70 - $\alpha$ )/40 for 30 deg < $\alpha$ < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610				
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305				
			C	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-				
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305			
			S	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-				
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305			
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305			
		<b>2.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for $\alpha \leq 30$ deg Cs = (70 - $\alpha$ )/40 for 30 deg < $\alpha$ < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-		
	7 TO 27			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-			
	28 TO 45			R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305		
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305		
	<b>3.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for $\alpha \leq 30$ deg Cs = (70 - $\alpha$ )/40 for 30 deg < $\alpha$ < 70 deg			OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
						S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
						C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	
			7 TO 27		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-		
28 TO 45			R		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305		
			C		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305		
ROUGH			0 TO 6		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			



Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT7: RT-E-Mount Mini II - Rafter off-centered with 7/16 OSB and (5)-60 mm screws - 60 Cells PV Panels - Portrait Orientation													
MAXIMUM SPACING OF RT-E MOUNT MINI (m)													
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY													
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa									
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10
<b>5.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-
		7 TO 27	R	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	ROUGH	0 TO 6	R	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	
		7 TO 27	R	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
<b>5.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	
		7 TO 27	R	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	ROUGH	0 TO 6	R	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	
		7 TO 27	R	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
<b>6.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	
		7 TO 27	R	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	ROUGH	0 TO 6	R	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	
		7 TO 27	R	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT8: RT-E-Mount Mini II - Rafter off-centered with 7/16 OSB and (5)-60 mm screws - 72 Cells PV Panels - Portrait Orientation																	
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																	
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																	
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa													
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10				
<b>0.50</b> $S = I_s(S_s * C_b * C_w * C_s * C_a + S_r)$ Ss and Sr from Code Tables Suggested values Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.829	1.829	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.305				
			S	1.829	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	-	-			
			C	0.914	0.610	0.305	0.305	0.305	-	-	-	-	-	-			
		7 TO 27	R	1.829	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-		
			S	1.829	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-	-		
			C	1.219	0.610	0.305	0.305	0.305	-	-	-	-	-	-	-		
		28 TO 45	R	2.438	2.438	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305		
			S	2.438	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305	-		
			C	2.438	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305	-		
		<b>1.00</b> $S = I_s(S_s * C_b * C_w * C_s * C_a + S_r)$ Ss and Sr from Code Tables Suggested values Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305		
					S	0.914	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	-	
					C	0.914	0.610	0.305	0.305	0.305	-	-	-	-	-	-	
	7 TO 27			R	0.914	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	
				S	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
				C	0.914	0.610	0.305	0.305	0.305	-	-	-	-	-	-	-	
	28 TO 45			R	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305	
				S	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305	-	
				C	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305	-	
	<b>1.50</b> $S = I_s(S_s * C_b * C_w * C_s * C_a + S_r)$ Ss and Sr from Code Tables Suggested values Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	
						S	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-
						C	0.610	0.610	0.305	0.305	0.305	-	-	-	-	-	-
			7 TO 27		R	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-
					S	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-	-
					C	0.610	0.610	0.305	0.305	0.305	-	-	-	-	-	-	-
28 TO 45			R		0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305	
			S		0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305	-	
			C		0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305	-	
ROUGH			0 TO 6		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
					S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
					C	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	-	
			7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-	
				C	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610		
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610		
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610		





Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT8: RT-E-Mount Mini II - Rafter off-centered with 7/16 OSB and (5)-60 mm screws - 72 Cells PV Panels - Portrait Orientation																		
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																		
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																		
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa														
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10					
<b>3.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305				
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-			
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-			
			C	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-			
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		<b>4.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-	-			
					S	-	-	-	-	-	-	-	-	-	-	-	-	
					C	-	-	-	-	-	-	-	-	-	-	-	-	
	7 TO 27			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-		
	28 TO 45			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	<b>4.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-	-		
						S	-	-	-	-	-	-	-	-	-	-	-	-
						C	-	-	-	-	-	-	-	-	-	-	-	-
			7 TO 27		R	-	-	-	-	-	-	-	-	-	-	-	-	
					S	-	-	-	-	-	-	-	-	-	-	-	-	
					C	-	-	-	-	-	-	-	-	-	-	-	-	
28 TO 45			R		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
ROUGH			0 TO 6		R	-	-	-	-	-	-	-	-	-	-	-		
					S	-	-	-	-	-	-	-	-	-	-	-		
					C	-	-	-	-	-	-	-	-	-	-	-		
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-		
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT8: RT-E-Mount Mini II - Rafter off-centered with 7/16 OSB and (5)-60 mm screws - 72 Cells PV Panels - Portrait Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>5.00</b>  $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	
		7 TO 27	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	ROUGH	0 TO 6	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	
		7 TO 27	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
<b>5.50</b>  $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-		
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	
		7 TO 27	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	
		28 TO 45	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	
	ROUGH	0 TO 6	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	
		7 TO 27	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	
		28 TO 45	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT9: RT-E-Mount Mini II - Plywood Only - 60 Cells PV Panels - Portrait Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>0.50</b> S = Is(Ss+Cb+CwCs+Ca + Sr) Ss and Sr from Code Tables Suggested values Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	1.524	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305			
			S	1.524	0.914	0.610	0.305	0.305	0.305	0.305	0.305	-	-			
			C	0.610	0.305	0.305	-	-	-	-	-	-	-			
		7 TO 27	R	1.524	0.914	0.610	0.305	0.305	0.305	0.305	0.305	-	-			
			S	0.914	0.610	0.305	0.305	0.305	-	-	-	-				
			C	0.610	0.305	0.305	-	-	-	-	-	-				
		28 TO 45	R	2.438	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305			
			S	1.829	1.219	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-			
			C	1.829	1.219	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-			
		<b>1.00</b> S = Is(Ss+Cb+CwCs+Ca + Sr) Ss and Sr from Code Tables Suggested values Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.134	1.524	0.914	0.610	0.610	0.305	0.305	0.305	0.305		
					S	1.524	0.914	0.610	0.305	0.305	0.305	0.305	0.305	-	-	
					C	0.610	0.305	0.305	-	-	-	-	-	-		
	7 TO 27			R	1.524	0.914	0.610	0.305	0.305	0.305	0.305	0.305	-	-		
				S	0.914	0.610	0.305	0.305	0.305	-	-	-	-			
				C	0.610	0.305	0.305	-	-	-	-	-	-			
	28 TO 45			R	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305		
				S	1.524	1.219	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-		
				C	1.524	1.219	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-		
	<b>1.50</b> S = Is(Ss+Cb+CwCs+Ca + Sr) Ss and Sr from Code Tables Suggested values Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	
						S	1.219	0.914	0.610	0.305	0.305	0.305	0.305	0.305	-	-
						C	0.610	0.305	0.305	-	-	-	-	-	-	
			7 TO 27		R	1.524	0.914	0.610	0.305	0.305	0.305	0.305	0.305	-	-	
					S	0.914	0.610	0.305	0.305	0.305	-	-	-	-		
					C	0.610	0.305	0.305	-	-	-	-	-	-		
28 TO 45			R		0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305		
			S		0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-		
			C		0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-		
ROUGH			0 TO 6		R	1.219	1.219	1.219	1.219	0.914	0.610	0.610	0.305	0.305		
					S	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305		
					C	0.914	0.610	0.305	0.305	0.305	-	-	-	-		
			7 TO 27	R	1.524	1.524	0.914	0.610	0.610	0.610	0.305	0.305	0.305			
				S	1.524	0.914	0.610	0.305	0.305	0.305	0.305	0.305	-			
				C	0.914	0.610	0.305	0.305	0.305	-	-	-	-			
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305			
			S	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	0.305			
			C	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	0.305			

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT9: RT-E-Mount Mini II - Plywood Only - 60 Cells PV Panels - Portrait Orientation

MAXIMUM SPACING OF RT-E MOUNT MINI (m)

SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY

SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa													
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10				
<b>2.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables Suggested values Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.914	0.914	0.610	0.305	0.305	0.305	0.305	0.305	-	-	-			
			C	0.610	0.305	0.305	-	-	-	-	-	-	-	-			
		7 TO 27	R	1.219	0.914	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-	-			
			S	0.914	0.610	0.305	0.305	0.305	-	-	-	-	-	-			
			C	0.610	0.305	0.305	-	-	-	-	-	-	-	-			
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-			
			C	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-			
		<b>2.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables Suggested values Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305		
					S	0.914	0.914	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
					C	0.610	0.305	0.305	-	-	-	-	-	-	-	-	
	7 TO 27			R	0.914	0.914	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-	-		
				S	0.914	0.610	0.305	0.305	0.305	-	-	-	-	-	-		
				C	0.610	0.305	0.305	-	-	-	-	-	-	-	-		
	28 TO 45			R	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-		
				C	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-		
	<b>3.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables Suggested values Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
						S	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-	-
						C	0.610	0.305	0.305	-	-	-	-	-	-	-	-
			7 TO 27		R	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
					S	0.610	0.610	0.305	0.305	0.305	-	-	-	-	-	-	
					C	0.610	0.305	0.305	-	-	-	-	-	-	-	-	
28 TO 45			R		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-		
			C		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-		
ROUGH			0 TO 6		R	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
					S	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.610	0.610	0.305	0.305	0.305	-	-	-	-	-	-	
			7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305		
				S	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-	-		
				C	0.610	0.610	0.305	0.305	0.305	-	-	-	-	-	-		
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT9: RT-E-Mount Mini II - Plywood Only - 60 Cells PV Panels - Portrait Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
<b>3.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305		
			S	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	-	
			C	0.610	0.305	0.305	-	-	-	-	-	-	-	-	
		7 TO 27	R	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
			S	0.610	0.610	0.305	0.305	0.305	-	-	-	-	-	-	
			C	0.610	0.305	0.305	-	-	-	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	
	<b>4.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
				C	0.305	0.305	0.305	-	-	-	-	-	-	-	-
			7 TO 27	R	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-	-
				S	0.610	0.610	0.305	0.305	0.305	-	-	-	-	-	-
				C	0.610	0.305	0.305	-	-	-	-	-	-	-	-
			28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
<b>4.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
				C	0.305	0.305	0.305	-	-	-	-	-	-	-	-
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
				S	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-
				C	0.305	0.305	0.305	-	-	-	-	-	-	-	-
			28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
		7 TO 27	R	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.610	0.610	0.305	0.305	0.305	-	-	-	-	-	-	
			C	0.610	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021

Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT9: RT-E-Mount Mini II - Plywood Only - 60 Cells PV Panels - Portrait Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
<b>5.00</b>  $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables  <i>Suggested values</i>  I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
			S	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-	-
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	-	-
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
			C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-	-
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
<b>5.50</b>  $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables  <i>Suggested values</i>  I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	-	-
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
			S	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-	-
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	-	-
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
			C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-	-
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
<b>6.00</b>  $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables  <i>Suggested values</i>  I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	-	-
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
			S	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-	-
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	-	-
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
			C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-	-
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT9: RT-E-Mount Mini II - Plywood Only - 60 Cells PV Panels - Portrait Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>6.50</b> $S = I_s(S_e C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
			S	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	
		28 TO 45	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
			C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	
		28 TO 45	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
<b>7.00</b> $S = I_s(S_e C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
			S	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	
		28 TO 45	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
			C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	
		28 TO 45	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
<b>7.50</b> $S = I_s(S_e C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
			S	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	
		28 TO 45	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
			C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	
		28 TO 45	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT9: RT-E-Mount Mini II - Plywood Only - 60 Cells PV Panels - Portrait Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>8.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
			S	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	-
		28 TO 45	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
			C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-
		28 TO 45	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
<b>8.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
			S	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	-
		28 TO 45	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
	ROUGH	0 TO 6	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
			C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-
		28 TO 45	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
<b>9.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
			S	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	-
		28 TO 45	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
	ROUGH	0 TO 6	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
			C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-
		28 TO 45	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-



Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT10: RT-E-Mount Mini II - Plywood Only - 72 Cells PV Panels - Portrait Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>0.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305
			S	1.524	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-	-
			C	0.610	0.305	-	-	-	-	-	-	-	-	-
		7 TO 27	R	1.524	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-	-
			S	0.914	0.305	0.305	0.305	-	-	-	-	-	-	-
			C	0.610	0.305	0.305	-	-	-	-	-	-	-	-
		28 TO 45	R	2.134	1.219	0.914	0.610	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	1.524	0.914	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-
			C	1.524	0.914	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-
	ROUGH	0 TO 6	R	2.438	2.134	1.524	0.914	0.914	0.610	0.610	0.305	0.305	0.305	
			S	2.438	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
			C	0.914	0.305	0.305	0.305	-	-	-	-	-	-	-
		7 TO 27	R	2.438	1.219	0.914	0.610	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	1.219	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	-
			C	0.914	0.610	0.305	0.305	-	-	-	-	-	-	-
		28 TO 45	R	2.438	1.829	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305
			S	2.438	1.524	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305
			C	2.438	1.524	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305
<b>1.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.829	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
			S	1.524	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-	-
			C	0.610	0.305	-	-	-	-	-	-	-	-	-
		7 TO 27	R	1.524	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-	-
			S	0.914	0.305	0.305	0.305	-	-	-	-	-	-	-
			C	0.610	0.305	0.305	-	-	-	-	-	-	-	-
		28 TO 45	R	1.219	1.219	0.914	0.610	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-
			C	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-
	ROUGH	0 TO 6	R	1.829	1.829	1.524	0.914	0.914	0.610	0.610	0.305	0.305	0.305	
			S	1.829	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
			C	0.914	0.305	0.305	0.305	-	-	-	-	-	-	-
		7 TO 27	R	1.829	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305
			S	1.219	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	-
			C	0.914	0.610	0.305	0.305	-	-	-	-	-	-	-
		28 TO 45	R	1.219	1.219	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305
			S	1.219	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305
			C	1.219	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305
<b>1.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
			S	1.219	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-	-
			C	0.610	0.305	-	-	-	-	-	-	-	-	-
		7 TO 27	R	1.219	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-	-
			S	0.914	0.305	0.305	0.305	-	-	-	-	-	-	-
			C	0.610	0.305	0.305	-	-	-	-	-	-	-	-
		28 TO 45	R	0.914	0.914	0.914	0.610	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-
			C	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-
	ROUGH	0 TO 6	R	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.305	0.305	0.305	
			S	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
			C	0.914	0.305	0.305	0.305	-	-	-	-	-	-	-
		7 TO 27	R	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305
			S	1.219	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	-
			C	0.914	0.610	0.305	0.305	-	-	-	-	-	-	-
		28 TO 45	R	0.914	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
			S	0.914	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
			C	0.914	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT10: RT-E-Mount Mini II - Plywood Only - 72 Cells PV Panels - Portrait Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>2.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
			S	0.914	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-	
			C	0.610	0.305	-	-	-	-	-	-	-	-	
		7 TO 27	R	0.914	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-	
			S	0.914	0.305	0.305	0.305	-	-	-	-	-	-	
			C	0.610	0.305	0.305	-	-	-	-	-	-	-	
		28 TO 45	R	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-	-	
			C	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-	-	
	ROUGH	0 TO 6	R	0.914	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305
			S	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.914	0.305	0.305	0.305	-	-	-	-	-	-	-
		7 TO 27	R	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.914	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	-
			C	0.914	0.610	0.305	0.305	-	-	-	-	-	-	-
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
<b>2.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
			S	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	
			C	0.610	0.305	-	-	-	-	-	-	-	-	-
		7 TO 27	R	0.914	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-	
			S	0.914	0.305	0.305	0.305	-	-	-	-	-	-	
			C	0.610	0.305	0.305	-	-	-	-	-	-	-	
		28 TO 45	R	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-	-	
			C	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-	-	
	ROUGH	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
			S	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.610	0.305	0.305	0.305	-	-	-	-	-	-	-
		7 TO 27	R	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.914	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	-
			C	0.914	0.610	0.305	0.305	-	-	-	-	-	-	-
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
<b>3.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
			S	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	
			C	0.610	0.305	-	-	-	-	-	-	-	-	-
		7 TO 27	R	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	
			S	0.610	0.305	0.305	0.305	-	-	-	-	-	-	
			C	0.610	0.305	0.305	-	-	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
	ROUGH	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
			S	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.610	0.305	0.305	0.305	-	-	-	-	-	-	-
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	-
			C	0.610	0.610	0.305	0.305	-	-	-	-	-	-	-
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT10: RT-E-Mount Mini II - Plywood Only - 72 Cells PV Panels - Portrait Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>3.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-		
			C	0.305	0.305	-	-	-	-	-	-	-	-	-		
		7 TO 27	R	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-			
			S	0.610	0.305	0.305	0.305	-	-	-	-	-	-			
			C	0.610	0.305	0.305	-	-	-	-	-	-	-			
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-		
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-		
	<b>4.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	
				C	0.305	0.305	-	-	-	-	-	-	-	-	-	
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	
				S	0.305	0.305	0.305	0.305	-	-	-	-	-	-	-	
				C	0.305	0.305	0.305	-	-	-	-	-	-	-	-	
			28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
<b>4.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	
				C	0.305	0.305	-	-	-	-	-	-	-	-	-	
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	
				S	0.305	0.305	0.305	0.305	-	-	-	-	-	-	-	
				C	0.305	0.305	0.305	-	-	-	-	-	-	-	-	
			28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	-	-	-	-	-	-	-		
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-		
			C	0.305	0.305	0.305	0.305	-	-	-	-	-	-	-		
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT10: RT-E-Mount Mini II - Plywood Only - 72 Cells PV Panels - Portrait Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>5.00</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	
			C	0.305	0.305	-	-	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-
			S	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-
			C	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
<b>5.50</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	
			C	0.305	0.305	-	-	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-
			S	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	
		28 TO 45	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-
			C	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
		28 TO 45	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
<b>6.00</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	
			C	0.305	0.305	-	-	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-
			S	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	
		28 TO 45	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-
			C	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
		28 TO 45	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT10: RT-E-Mount Mini II - Plywood Only - 72 Cells PV Panels - Portrait Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>6.50</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-
			C	0.305	0.305	-	-	-	-	-	-	-	-	-
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-
			S	0.305	0.305	0.305	0.305	-	-	-	-	-	-	-
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	-
		28 TO 45	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	
			C	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
		28 TO 45	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	
<b>7.00</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	
			C	0.305	0.305	-	-	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
			S	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	
		28 TO 45	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C	0.305	0.305	0.305	0.305	-	-	-	-	-		
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-		
			C	0.305	0.305	0.305	0.305	-	-	-	-	-		
		28 TO 45	R	-	-	-	-	-	-	-	-	-		
			S	-	-	-	-	-	-	-	-	-		
			C	-	-	-	-	-	-	-	-	-		
<b>7.50</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-		
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
			S	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	
		28 TO 45	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	
	ROUGH	0 TO 6	R	-	-	-	-	-	-	-	-	-		
			S	-	-	-	-	-	-	-	-	-		
			C	-	-	-	-	-	-	-	-	-		
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-		
			C	0.305	0.305	0.305	0.305	-	-	-	-	-		
		28 TO 45	R	-	-	-	-	-	-	-	-	-		
			S	-	-	-	-	-	-	-	-	-		
			C	-	-	-	-	-	-	-	-	-		

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT11: RT-E-Mount Mini II - OSB Only - 60 Cells PV Panels - Portrait Orientation																	
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																	
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																	
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa													
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10				
<b>0.50</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.829	1.219	0.914	0.610	0.305	0.305	0.305	0.305	0.305	-				
			S	1.219	0.610	0.610	0.305	0.305	0.305	-	-	-	-	-			
			C	0.305	0.305	-	-	-	-	-	-	-	-	-			
		7 TO 27	R	1.219	0.610	0.610	0.305	0.305	0.305	-	-	-	-	-			
			S	0.610	0.305	0.305	0.305	-	-	-	-	-	-	-			
			C	0.610	0.305	-	-	-	-	-	-	-	-	-			
		28 TO 45	R	1.829	1.219	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-			
			S	1.524	0.914	0.610	0.305	0.305	0.305	0.305	0.305	-	-	-			
			C	1.524	0.914	0.610	0.305	0.305	0.305	0.305	0.305	-	-	-			
		<b>1.00</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.914	0.914	0.914	0.610	0.305	0.305	0.305	0.305	0.305	-		
					S	0.914	0.610	0.610	0.305	0.305	0.305	-	-	-	-	-	
					C	0.305	0.305	-	-	-	-	-	-	-	-	-	
	7 TO 27			R	1.219	0.610	0.610	0.305	0.305	0.305	-	-	-	-	-		
				S	0.610	0.305	0.305	0.305	-	-	-	-	-	-	-		
				C	0.610	0.305	-	-	-	-	-	-	-	-	-		
	28 TO 45			R	1.219	1.219	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-		
				S	1.219	0.914	0.610	0.305	0.305	0.305	0.305	0.305	-	-	-		
				C	1.219	0.914	0.610	0.305	0.305	0.305	0.305	0.305	-	-	-		
	<b>1.50</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	
						S	0.610	0.610	0.610	0.305	0.305	0.305	-	-	-	-	-
						C	0.305	0.305	-	-	-	-	-	-	-	-	-
			7 TO 27		R	0.914	0.610	0.610	0.305	0.305	0.305	-	-	-	-	-	
					S	0.610	0.305	0.305	0.305	-	-	-	-	-	-	-	
					C	0.610	0.305	-	-	-	-	-	-	-	-	-	
28 TO 45			R		0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-		
			S		0.914	0.914	0.610	0.305	0.305	0.305	0.305	0.305	-	-	-		
			C		0.914	0.914	0.610	0.305	0.305	0.305	0.305	0.305	-	-	-		
ROUGH			0 TO 6		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	
					S	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.610	0.305	0.305	0.305	-	-	-	-	-	-	-	
			7 TO 27	R	0.914	0.914	0.914	0.610	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.914	0.610	0.610	0.305	0.305	0.305	-	-	-	-	-		
				C	0.914	0.305	0.305	0.305	-	-	-	-	-	-	-		
		28 TO 45	R	1.219	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305			
			S	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305			
			C	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305			

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT11: RT-E-Mount Mini II - OSB Only - 60 Cells PV Panels - Portrait Orientation													
MAXIMUM SPACING OF RT-E MOUNT MINI (m)													
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY													
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa									
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10
<b>2.00</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-
			S	0.610	0.610	0.610	0.305	0.305	-	-	-	-	-
			C	0.305	0.305	-	-	-	-	-	-	-	-
		7 TO 27	R	0.610	0.610	0.610	0.305	0.305	0.305	-	-	-	-
			S	0.610	0.305	0.305	0.305	-	-	-	-	-	-
			C	0.610	0.305	-	-	-	-	-	-	-	-
		28 TO 45	R	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-
			S	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	-
			C	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	-
	ROUGH	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305
			S	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.610	0.305	0.305	0.305	-	-	-	-	-	-
		7 TO 27	R	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.610	0.610	0.610	0.305	0.305	0.305	-	-	-	-
			C	0.610	0.305	0.305	0.305	-	-	-	-	-	-
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
			S	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305
			C	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305
<b>2.50</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
			S	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	-
			C	0.305	0.305	-	-	-	-	-	-	-	-
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	-
			S	0.305	0.305	0.305	0.305	-	-	-	-	-	-
			C	0.305	0.305	-	-	-	-	-	-	-	-
		28 TO 45	R	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-
			S	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	-
			C	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	-
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	-	-	-	-	-	-
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	-
			C	0.305	0.305	0.305	0.305	-	-	-	-	-	-
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
			S	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305
			C	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305
<b>3.00</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
			S	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	-
			C	0.305	0.305	-	-	-	-	-	-	-	-
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	-
			S	0.305	0.305	0.305	0.305	-	-	-	-	-	-
			C	0.305	0.305	-	-	-	-	-	-	-	-
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	-	-	-	-	-	-
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	-
			C	0.305	0.305	0.305	0.305	-	-	-	-	-	-
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT11: RT-E-Mount Mini II - OSB Only - 60 Cells PV Panels - Portrait Orientation													
MAXIMUM SPACING OF RT-E MOUNT MINI (m)													
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY													
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa									
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10
<b>3.50</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
			S	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	-
			C	0.305	0.305	-	-	-	-	-	-	-	-
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	-
			S	0.305	0.305	0.305	0.305	-	-	-	-	-	
			C	0.305	0.305	-	-	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	
			C	0.305	0.305	0.305	0.305	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
<b>4.00</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
			S	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	
			C	0.305	0.305	-	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	
			S	0.305	0.305	0.305	0.305	-	-	-	-		
			C	0.305	0.305	-	-	-	-	-	-		
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	
			C	0.305	0.305	0.305	0.305	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
<b>4.50</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	
			S	0.305	0.305	0.305	0.305	-	-	-	-		
			C	0.305	0.305	-	-	-	-	-	-		
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	
	ROUGH	0 TO 6	R	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-		
			C	-	-	-	-	-	-	-	-		
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	-	-		
			C	0.305	0.305	0.305	0.305	-	-	-	-		
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		



Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT11: RT-E-Mount Mini II - OSB Only - 60 Cells PV Panels - Portrait Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
<b>5.00</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-	-		
			S	-	-	-	-	-	-	-	-	-	-		
			C	-	-	-	-	-	-	-	-	-	-		
		7 TO 27	R	-	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
	ROUGH	0 TO 6	R	-	-	-	-	-	-	-	-	-	-		
			S	-	-	-	-	-	-	-	-	-	-		
			C	-	-	-	-	-	-	-	-	-	-		
		7 TO 27	R	-	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	<b>5.50</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-		
				S	-	-	-	-	-	-	-	-	-	-	
				C	-	-	-	-	-	-	-	-	-	-	
			7 TO 27	R	-	-	-	-	-	-	-	-	-	-	-
				S	-	-	-	-	-	-	-	-	-	-	-
				C	-	-	-	-	-	-	-	-	-	-	-
28 TO 45			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
ROUGH		0 TO 6	R	-	-	-	-	-	-	-	-	-	-		
			S	-	-	-	-	-	-	-	-	-	-		
			C	-	-	-	-	-	-	-	-	-	-		
		7 TO 27	R	-	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT12: RT-E-Mount Mini II - OSB Only - 72 Cells PV Panels - Portrait Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>0.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.829	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	-		
			S	1.219	0.610	0.305	0.305	-	-	-	-	-	-	-	-	
			C	0.305	0.305	-	-	-	-	-	-	-	-	-	-	
		7 TO 27	R	1.219	0.610	0.305	0.305	0.305	-	-	-	-	-	-	-	
			S	0.610	0.305	0.305	-	-	-	-	-	-	-	-	-	
			C	0.305	0.305	-	-	-	-	-	-	-	-	-	-	
		28 TO 45	R	1.524	0.914	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	
			S	1.219	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	-	-	-	
			C	1.219	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	-	-	-	
	<b>1.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	-	
				S	0.914	0.610	0.305	0.305	0.305	-	-	-	-	-	-	-
				C	0.305	0.305	-	-	-	-	-	-	-	-	-	-
			7 TO 27	R	0.914	0.610	0.305	0.305	0.305	-	-	-	-	-	-	-
				S	0.610	0.305	0.305	-	-	-	-	-	-	-	-	-
				C	0.305	0.305	-	-	-	-	-	-	-	-	-	-
			28 TO 45	R	1.219	0.914	0.610	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
				S	1.219	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	-	-	-
				C	1.219	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	-	-	-
<b>1.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	-	
				S	0.610	0.610	0.305	0.305	0.305	-	-	-	-	-	-	-
				C	0.305	0.305	-	-	-	-	-	-	-	-	-	-
			7 TO 27	R	0.610	0.610	0.305	0.305	0.305	-	-	-	-	-	-	-
				S	0.610	0.305	0.305	-	-	-	-	-	-	-	-	-
				C	0.305	0.305	-	-	-	-	-	-	-	-	-	-
			28 TO 45	R	0.914	0.914	0.610	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
				S	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	-	-	-
				C	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	-	-	-
	ROUGH	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305		
			S	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-	-		
			C	0.610	0.305	0.305	-	-	-	-	-	-	-	-		
		7 TO 27	R	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	-		
			S	0.610	0.610	0.305	0.305	0.305	-	-	-	-	-	-		
			C	0.610	0.305	0.305	-	-	-	-	-	-	-	-		
		28 TO 45	R	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305		
			S	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305		
			C	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305		

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021

Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT12: RT-E-Mount Mini II - OSB Only - 72 Cells PV Panels - Portrait Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>2.00</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-		
			S	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-	-	
			C	0.305	0.305	-	-	-	-	-	-	-	-	-	-	
		7 TO 27	R	0.610	0.610	0.305	0.305	0.305	-	-	-	-	-	-	-	
			S	0.610	0.305	0.305	-	-	-	-	-	-	-	-	-	
			C	0.305	0.305	-	-	-	-	-	-	-	-	-	-	
		28 TO 45	R	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
			S	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	
			C	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	
	<b>2.50</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
				S	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-	-
				C	0.305	0.305	-	-	-	-	-	-	-	-	-	-
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-	-
				S	0.305	0.305	0.305	-	-	-	-	-	-	-	-	-
				C	0.305	0.305	-	-	-	-	-	-	-	-	-	-
			28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-
<b>3.00</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
				S	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-	-
				C	0.305	0.305	-	-	-	-	-	-	-	-	-	-
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-	-
				S	0.305	0.305	0.305	-	-	-	-	-	-	-	-	-
				C	0.305	0.305	-	-	-	-	-	-	-	-	-	-
			28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-		
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	-		
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
			S	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-	-	
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT12: RT-E-Mount Mini II - OSB Only - 72 Cells PV Panels - Portrait Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
<b>3.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-		
			S	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
			C	0.305	0.305	-	-	-	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
			S	0.305	0.305	0.305	-	-	-	-	-	-	-	-	
			C	0.305	0.305	-	-	-	-	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	
	<b>4.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-		
				S	-	-	-	-	-	-	-	-	-	-	-
				C	-	-	-	-	-	-	-	-	-	-	-
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-
				S	0.305	0.305	0.305	-	-	-	-	-	-	-	-
				C	0.305	0.305	-	-	-	-	-	-	-	-	-
			28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
<b>4.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-		
				S	-	-	-	-	-	-	-	-	-	-	-
				C	-	-	-	-	-	-	-	-	-	-	-
			7 TO 27	R	-	-	-	-	-	-	-	-	-	-	-
				S	-	-	-	-	-	-	-	-	-	-	-
				C	-	-	-	-	-	-	-	-	-	-	-
			28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-
	ROUGH	0 TO 6	R	-	-	-	-	-	-	-	-	-	-		
			S	-	-	-	-	-	-	-	-	-	-		
			C	-	-	-	-	-	-	-	-	-	-		
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
			S	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
			C	0.305	0.305	0.305	-	-	-	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT13: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-60 mm screws - 60 or 72 cells - Landscape Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>0.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829			
			S	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219			
			C	2.438	2.438	1.829	1.219	1.219	0.914	0.914	0.610	0.610	0.610			
		7 TO 27	R	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219			
			S	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914			
			C	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610			
		28 TO 45	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829		
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524			
			C	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524			
		<b>1.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	
					S	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219	
					C	2.438	2.438	1.829	1.219	1.219	0.914	0.914	0.610	0.610	0.610	
	7 TO 27			R	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219		
				S	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914		
				C	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610		
	28 TO 45			R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	
				S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524		
				C	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524		
	<b>1.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829
						S	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219
						C	2.438	2.438	1.829	1.219	1.219	0.914	0.914	0.610	0.610	0.610
			7 TO 27		R	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219	
					S	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914	
					C	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610	
28 TO 45			R		2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	
			S		2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524		
			C		2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524		
ROUGH			0 TO 6		R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829
					S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	
					C	2.438	2.438	2.438	2.134	1.524	1.524	1.219	0.914	0.914	0.914	
			7 TO 27	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	
				S	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219		
				C	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914		
		28 TO 45	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438		
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438		
			C	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438		

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT13: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-60 mm screws - 60 or 72 cells - Landscape Orientation																	
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																	
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																	
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa													
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10				
<b>2.00</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829				
			S	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219	1.219			
			C	2.438	2.438	1.829	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610			
		7 TO 27	R	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219	1.219			
			S	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914	0.914			
			C	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610			
		28 TO 45	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829			
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524			
			C	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524			
		<b>2.50</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829		
					S	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219	1.219	
					C	2.438	2.438	1.829	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610	
	7 TO 27			R	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219	1.219		
				S	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914	0.914		
				C	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610		
	28 TO 45			R	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829		
				S	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524		
				C	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524		
	<b>3.00</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	1.829	
						S	2.134	2.134	2.134	2.134	2.134	2.134	2.134	1.829	1.829	1.524	1.219
						C	2.134	2.134	1.829	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610
			7 TO 27		R	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219	1.219	
					S	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914	0.914	
					C	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610	
28 TO 45			R		1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524		
			S		1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524		
			C		1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524		
ROUGH			0 TO 6		R	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	
					S	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	
					C	2.134	2.134	2.134	2.134	1.524	1.524	1.219	0.914	0.914	0.914	0.914	
			7 TO 27	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	2.134		
				S	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219	1.219		
				C	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914	0.914		
		28 TO 45	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524			
			S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524			
			C	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524			

Table: RT13: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-60 mm screws - 60 or 72 cells - Landscape Orientation																	
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																	
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																	
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa													
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10				
<b>3.50</b> S = $I_s(S_s C_b C_w C_s C_a + S_r)$ S <sub>s</sub> and S <sub>r</sub> from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α <= 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829			
			S	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.219		
			C	1.829	1.829	1.829	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.610		
		7 TO 27	R	2.134	2.134	2.134	2.134	2.134	2.134	2.134	1.829	1.829	1.829	1.524	1.219		
			S	2.134	2.134	2.134	2.134	2.134	1.829	1.524	1.219	1.219	0.914	0.914	0.914		
			C	2.134	2.134	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.610		
		28 TO 45	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524		
			S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524		
			C	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524		
		ROUGH	0 TO 6	R	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829		
				S	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	
				C	1.829	1.829	1.829	1.829	1.524	1.524	1.219	0.914	0.914	0.914	0.914	0.914	
	7 TO 27		R	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134		
			S	2.134	2.134	2.134	2.134	2.134	2.134	2.134	1.829	1.524	1.524	1.219	0.914		
			C	2.134	2.134	2.134	2.134	1.829	1.524	1.219	1.219	0.914	0.914	0.914	0.914		
	28 TO 45		R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524		
			S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524		
			C	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524		
	<b>4.00</b> S = $I_s(S_s C_b C_w C_s C_a + S_r)$ S <sub>s</sub> and S <sub>r</sub> from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α <= 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	
					S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219
					C	1.524	1.524	1.524	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.610
		7 TO 27		R	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.219	
				S	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.219	1.219	0.914	0.914	0.914	
				C	1.829	1.829	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.610	
28 TO 45		R		1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
		S		1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
		C		1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
ROUGH		0 TO 6		R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524		
				S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	
				C	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	0.914	0.914	0.914	0.914	
		7 TO 27	R	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.219		
			S	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.524	1.219		
			C	1.829	1.829	1.829	1.829	1.829	1.524	1.219	1.219	0.914	0.914	0.914	0.914		
		28 TO 45	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
			C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
		<b>4.50</b> S = $I_s(S_s C_b C_w C_s C_a + S_r)$ S <sub>s</sub> and S <sub>r</sub> from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α <= 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	
					S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219
					C	1.524	1.524	1.524	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.610
7 TO 27				R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	
				S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	
				C	1.524	1.524	1.524	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.610	
28 TO 45	R			0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
	S			0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
	C			0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
ROUGH	0 TO 6			R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524		
				S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	
				C	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	0.914	0.914	0.914	0.914	
	7 TO 27		R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524		
			S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219		
			C	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	0.914		
	28 TO 45		R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		

Project Name: RT-MINI II-BC (BCBC2018)

Date: 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT13: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-60 mm screws - 60 or 72 cells - Landscape Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>5.00</b> $S = Is(Ss^{1/2} Cb^{1/2} Cw^{1/2} Cs^{1/2} Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219
			C	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610
		7 TO 27	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219
			S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914
			C	1.524	1.524	1.524	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
	ROUGH	0 TO 6	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
			C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.914	
		7 TO 27	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	
			S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	
			C	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
<b>5.50</b> $S = Is(Ss^{1/2} Cb^{1/2} Cw^{1/2} Cs^{1/2} Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
			C	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	
		7 TO 27	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	
			C	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
	ROUGH	0 TO 6	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
			C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.914	
		7 TO 27	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
			C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
<b>6.00</b> $S = Is(Ss^{1/2} Cb^{1/2} Cw^{1/2} Cs^{1/2} Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	
		7 TO 27	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	
			C	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
	ROUGH	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
		7 TO 27	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
			C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	



Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT13: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-60 mm screws - 60 or 72 cells - Landscape Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>6.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914			
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914			
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610		
		7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610		
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
		<b>7.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
					S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
					C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610
	7 TO 27			R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
				C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	
	28 TO 45			R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
	<b>7.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70			OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
						S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
						C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610
			7 TO 27		R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
					S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
					C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610
28 TO 45			R		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
ROUGH			0 TO 6		R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
					S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
					C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
				C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT13: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-60 mm screws - 60 or 72 cells - Landscape Orientation																		
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																		
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																		
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa														
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10					
<b>8.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610				
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
		7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914			
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914			
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610			
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
		<b>8.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
					S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
					C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
	7 TO 27			R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
				C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610		
	28 TO 45			R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
	<b>9.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70			OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
						S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
						C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			7 TO 27		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
					S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
					C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
28 TO 45			R		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
ROUGH			0 TO 6		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
					S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
					C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT13: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-60 mm screws - 60 or 72 cells - Landscape Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>9.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ S <sub>s</sub> and S <sub>r</sub> from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	ROUGH	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
<b>10.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ S <sub>s</sub> and S <sub>r</sub> from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
	ROUGH	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT14: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-90 mm screws - 60 or 72 cells - Landscape Orientation																			
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																			
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																			
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa															
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10						
<b>0.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219				
			S	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	0.914	0.610	0.610	0.610			
			C	2.438	2.438	1.829	1.219	1.219	0.914	0.610	0.610	0.610	0.610	0.610	0.610	0.610			
		7 TO 27	R	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219	0.914	0.914	0.914			
			S	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914	0.610	0.610	0.610			
			C	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.610	0.610			
		28 TO 45	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219		
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219	1.524	1.219		
			C	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219	1.524	1.219		
	<b>1.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219		
				S	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	0.914	0.610	0.610	0.610		
				C	2.438	2.438	1.829	1.219	1.219	0.914	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			7 TO 27	R	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219	0.914	0.914	0.914		
				S	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914	0.610	0.610	0.610		
				C	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.610	0.610		
			28 TO 45	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219
				S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219	1.524	1.219	
				C	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219	1.524	1.219	
<b>1.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219		
				S	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	0.914	0.610	0.610	0.610		
				C	2.438	2.438	1.829	1.219	1.219	0.914	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			7 TO 27	R	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219	0.914	0.914	0.914		
				S	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914	0.610	0.610	0.610		
				C	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.610	0.610		
			28 TO 45	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219
				S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219	1.524	1.219	
				C	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219	1.524	1.219	
	ROUGH	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438		
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	
			C	2.438	2.438	2.438	2.134	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.610	0.610		
		7 TO 27	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	2.134	2.134		
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219	1.219	1.219		
			C	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610		
		28 TO 45	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438		
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438		
			C	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438		

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT14: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-90 mm screws - 60 or 72 cells - Landscape Orientation																	
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																	
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																	
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa													
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10				
<b>2.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829			
			S	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219				
			C	2.438	2.438	1.829	1.219	1.219	0.914	0.610	0.610	0.610	0.610				
		7 TO 27	R	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219				
			S	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914				
			C	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610				
		28 TO 45	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829			
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219			
			C	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219			
		<b>2.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	
					S	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219		
					C	2.438	2.438	1.829	1.219	1.219	0.914	0.610	0.610	0.610	0.610		
	7 TO 27			R	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219			
				S	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914			
				C	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610			
	28 TO 45			R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	
				S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	
				C	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219	
	<b>3.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	1.829
						S	2.134	2.134	2.134	2.134	2.134	2.134	1.829	1.524	1.524	1.219	
						C	2.134	2.134	1.829	1.219	1.219	0.914	0.610	0.610	0.610	0.610	
			7 TO 27		R	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	1.219		
					S	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914		
					C	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610		
28 TO 45			R		2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	1.829	
			S		2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	1.829	1.829	1.524	1.219	
			C		2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	1.829	1.829	1.524	1.219	
ROUGH			0 TO 6		R	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134
					S	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	1.829
					C	2.134	2.134	2.134	2.134	1.524	1.219	1.219	0.914	0.914	0.914		
			7 TO 27	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	2.134	
				S	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219			
				C	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	0.914			
		28 TO 45	R	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134		
			S	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134		
			C	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134		

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT14: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-90 mm screws - 60 or 72 cells - Landscape Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>3.50</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829			
			S	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.524	1.219			
			C	1.829	1.829	1.829	1.219	1.219	0.914	0.610	0.610	0.610	0.610			
		7 TO 27	R	2.134	2.134	2.134	2.134	2.134	2.134	1.829	1.829	1.524	1.219			
			S	2.134	2.134	2.134	2.134	1.829	1.524	1.219	1.219	0.914	0.914			
			C	2.134	2.134	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610			
		28 TO 45	R	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829			
			S	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524			
			C	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524			
		<b>4.00</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524		
					S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	
					C	1.524	1.524	1.524	1.219	1.219	0.914	0.610	0.610	0.610	0.610	
	7 TO 27			R	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.219		
				S	1.829	1.829	1.829	1.829	1.829	1.524	1.219	1.219	0.914	0.914		
				C	1.829	1.829	1.829	1.524	1.219	0.914	0.610	0.610	0.610	0.610		
	28 TO 45			R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524		
				S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524		
				C	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524		
	<b>4.50</b> $S = I_s(S_s C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	
						S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219
						C	1.524	1.524	1.524	1.219	1.219	0.914	0.610	0.610	0.610	0.610
			7 TO 27		R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	
					S	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	
					C	1.524	1.524	1.524	1.524	1.219	0.914	0.914	0.610	0.610	0.610	
28 TO 45			R		1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
			S		1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
			C		1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
ROUGH			0 TO 6		R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524		
					S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	
					C	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	0.914	
			7 TO 27	R	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.219		
				S	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.524	1.219		
				C	1.829	1.829	1.829	1.829	1.829	1.524	1.219	1.219	0.914	0.914		
		28 TO 45	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524			
			S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524			
			C	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524			

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT14: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-90 mm screws - 60 or 72 cells - Landscape Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>5.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219			
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
			C	1.219	1.219	1.219	1.219	1.219	0.914	0.610	0.610	0.610	0.610	0.610		
		7 TO 27	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219		
			S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914		
			C	1.524	1.524	1.524	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610		
		28 TO 45	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
			C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
		ROUGH	0 TO 6	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
				S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
				C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.914	0.914	
	7 TO 27		R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219		
			S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219		
			C	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914		
	28 TO 45		R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
			C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
	<b>5.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
					S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219
					C	1.219	1.219	1.219	1.219	1.219	0.914	0.610	0.610	0.610	0.610	0.610
		7 TO 27		R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
				S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	
				C	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	
28 TO 45		R		1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
		S		1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
		C		1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
ROUGH		0 TO 6		R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
				S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
				C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.914	
		7 TO 27	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
			C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914		
		28 TO 45	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
			C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
		<b>6.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
					S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
					C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610
7 TO 27				R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
				S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	
				C	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	
28 TO 45	R			0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
	S			0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
	C			0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
ROUGH	0 TO 6			R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
				C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
	7 TO 27		R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
			C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914		
	28 TO 45		R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT14: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-90 mm screws - 60 or 72 cells - Landscape Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>6.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914			
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610			
		7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610			
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
		<b>7.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
					S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
					C	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	
	7 TO 27			R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
				C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	
	28 TO 45			R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
				C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
	<b>7.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70			OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
						S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
						C	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610
			7 TO 27		R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
					S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
					C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610
28 TO 45			R		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
ROUGH			0 TO 6		R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
					S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
					C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
				C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		



Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT14: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-90 mm screws - 60 or 72 cells - Landscape Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
<b>8.00</b>  $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
		7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
		ROUGH	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
	7 TO 27		R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
	28 TO 45		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
	<b>8.50</b>  $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70		OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
					S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
					C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
		7 TO 27		R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
				C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610
28 TO 45		R		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
		S		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
		C		0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
ROUGH		0 TO 6		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
		7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
		<b>9.00</b>  $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
					S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
					C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
7 TO 27				R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
28 TO 45	R			0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
	S			0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
	C			0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
ROUGH	0 TO 6			R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
	7 TO 27		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
	28 TO 45		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT14: RT-E-Mount Mini II - Rafter centered with 15/32 plywood and (2)-90 mm screws - 60 or 72 cells - Landscape Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>9.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
	ROUGH	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
<b>10.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
	ROUGH	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT15: RT-E-Mount Mini II - Rafter centered with 7/16 OSB and (6)-60 mm screws - 60 or 72 cells - Landscape Orientation																		
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																		
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																		
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa														
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10					
<b>0.50</b> $S = Is(Ss^2Cb^2Cw^2Cs^2Ca + Sr)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524			
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524			
			C	2.438	2.438	2.134	1.524	1.219	1.219	0.914	0.914	0.610	0.610					
		7 TO 27	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524				
			S	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914					
			C	2.438	2.438	2.134	1.829	1.524	1.219	0.914	0.914	0.610	0.610					
		28 TO 45	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829			
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829				
			C	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829				
		<b>1.00</b> $S = Is(Ss^2Cb^2Cw^2Cs^2Ca + Sr)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	
					S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524		
					C	2.438	2.438	2.134	1.524	1.219	1.219	0.914	0.914	0.610	0.610			
	7 TO 27			R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524			
				S	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914				
				C	2.438	2.438	2.134	1.829	1.524	1.219	0.914	0.914	0.610	0.610				
	28 TO 45			R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829		
				S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829			
				C	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829			
	<b>1.50</b> $S = Is(Ss^2Cb^2Cw^2Cs^2Ca + Sr)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524
						S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	
						C	2.438	2.438	2.134	1.524	1.219	1.219	0.914	0.914	0.610	0.610		
			7 TO 27		R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524		
					S	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914			
					C	2.438	2.438	2.134	1.829	1.524	1.219	0.914	0.914	0.610	0.610			
28 TO 45			R		2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829		
			S		2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829			
			C		2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829			
ROUGH			0 TO 6		R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	
					S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	
					C	2.438	2.438	2.438	2.438	2.134	1.524	1.524	1.219	1.219	0.914			
			7 TO 27	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438		
				S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524			
				C	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	1.219				
		28 TO 45	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438			
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438			
			C	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438			

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description Calculation of mount capacities

Checker: MG

Table: RT15: RT-E-Mount Mini II - Rafter centered with 7/16 OSB and (6)-60 mm screws - 60 or 72 cells - Landscape Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>2.00</b>  S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	
			C	2.438	2.438	2.134	1.524	1.219	1.219	0.914	0.914	0.610	0.610	
		7 TO 27	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	
			S	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	
			C	2.438	2.438	2.134	1.829	1.524	1.219	0.914	0.914	0.914	0.610	
		28 TO 45	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	
			C	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	
	ROUGH	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	
			C	2.438	2.438	2.438	2.438	2.134	1.524	1.524	1.219	1.219	0.914	
		7 TO 27	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	
			C	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	1.219	
		28 TO 45	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	
			C	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	
<b>2.50</b>  S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	
			C	2.438	2.438	2.134	1.524	1.219	1.219	0.914	0.914	0.610	0.610	
		7 TO 27	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524
			S	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	
			C	2.438	2.438	2.134	1.829	1.524	1.219	0.914	0.914	0.914	0.610	
		28 TO 45	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829
			C	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829
	ROUGH	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	
			C	2.438	2.438	2.438	2.438	2.134	1.524	1.524	1.219	1.219	0.914	
		7 TO 27	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	
			C	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	1.219	
		28 TO 45	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	
			C	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	
<b>3.00</b>  S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	
			S	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	1.829	1.524	
			C	2.134	2.134	2.134	1.524	1.219	1.219	0.914	0.914	0.610	0.610	
		7 TO 27	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524
			S	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	
			C	2.438	2.438	2.134	1.829	1.524	1.219	0.914	0.914	0.914	0.610	
		28 TO 45	R	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829
			S	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829
			C	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829
	ROUGH	0 TO 6	R	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	
			S	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	
			C	2.134	2.134	2.134	2.134	2.134	1.524	1.524	1.219	1.219	0.914	
		7 TO 27	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.438	
			S	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	
			C	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	1.219	
		28 TO 45	R	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	
			S	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	
			C	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT15: RT-E-Mount Mini II - Rafter centered with 7/16 OSB and (6)-60 mm screws - 60 or 72 cells - Landscape Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>3.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829		
			S	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	
			C	1.829	1.829	1.829	1.524	1.219	1.219	0.914	0.914	0.610	0.610			
		7 TO 27	R	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	2.134	1.829	1.524		
			S	2.134	2.134	2.134	2.134	2.134	1.829	1.524	1.219	1.219	0.914	0.610		
			C	2.134	2.134	2.134	1.829	1.524	1.219	0.914	0.914	0.610	0.610			
		28 TO 45	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	
			S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	
			C	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	
	<b>4.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524		
				S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524
				C	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	0.610	0.610		
			7 TO 27	R	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524
				S	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.219	1.219	0.914	0.610
				C	1.829	1.829	1.829	1.829	1.524	1.219	0.914	0.914	0.610	0.610		
			28 TO 45	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524
				S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524
				C	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524
<b>4.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	
				S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524
				C	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.914	0.610	0.610		
			7 TO 27	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524
				S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914	0.610
				C	1.524	1.524	1.524	1.524	1.524	1.219	0.914	0.914	0.610	0.610		
			28 TO 45	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219
				S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219
				C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219
	ROUGH	0 TO 6	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524		
			S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524		
			C	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914			
		7 TO 27	R	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	
			S	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	
			C	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.219	1.219	0.914		
		28 TO 45	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	
			S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	
			C	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT15: RT-E-Mount Mini II - Rafter centered with 7/16 OSB and (6)-60 mm screws - 60 or 72 cells - Landscape Orientation																	
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																	
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																	
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa													
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10				
<b>5.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219				
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219				
			C	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610				
		7 TO 27	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524			
			S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	0.914			
			C	1.524	1.524	1.524	1.524	1.524	1.219	0.914	0.914	0.914	0.610				
		28 TO 45	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219			
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219			
			C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219			
		<b>5.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
					S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
					C	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610		
	7 TO 27			R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
				S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914		
				C	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.914	0.610			
	28 TO 45			R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
				C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
	<b>6.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
						S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
						C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610
			7 TO 27		R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
					S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	
					C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.914	0.610	
28 TO 45			R		0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
			S		0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
			C		0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
ROUGH			0 TO 6		R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
					S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
					C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			7 TO 27	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
				S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
				C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914			
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914			
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914			

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT15: RT-E-Mount Mini II - Rafter centered with 7/16 OSB and (6)-60 mm screws - 60 or 72 cells - Landscape Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE $\alpha$ (deg.)	ROOF ZONE	BASIC WIND PRESSURE $q$ (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>6.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ <i>Ss and Sr from Code Tables</i> <b>Suggested values</b> <i>I<sub>s</sub> = 1.0</i> <i>C<sub>b</sub> = 0.8</i> <i>C<sub>w</sub> = 1.0</i> <i>C<sub>a</sub> = 1.0</i> <i>C<sub>s</sub> = 1.0 for <math>\alpha \leq 30</math> deg</i> <i>C<sub>s</sub> = (70 - <math>\alpha</math>)/40 for 30 deg &lt; <math>\alpha</math> &lt; 70</i>	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610
		7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
	ROUGH	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
		7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
<b>7.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ <i>Ss and Sr from Code Tables</i> <b>Suggested values</b> <i>I<sub>s</sub> = 1.0</i> <i>C<sub>b</sub> = 0.8</i> <i>C<sub>w</sub> = 1.0</i> <i>C<sub>a</sub> = 1.0</i> <i>C<sub>s</sub> = 1.0 for <math>\alpha \leq 30</math> deg</i> <i>C<sub>s</sub> = (70 - <math>\alpha</math>)/40 for 30 deg &lt; <math>\alpha</math> &lt; 70</i>	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610
		7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
	ROUGH	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
		7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
<b>7.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ <i>Ss and Sr from Code Tables</i> <b>Suggested values</b> <i>I<sub>s</sub> = 1.0</i> <i>C<sub>b</sub> = 0.8</i> <i>C<sub>w</sub> = 1.0</i> <i>C<sub>a</sub> = 1.0</i> <i>C<sub>s</sub> = 1.0 for <math>\alpha \leq 30</math> deg</i> <i>C<sub>s</sub> = (70 - <math>\alpha</math>)/40 for 30 deg &lt; <math>\alpha</math> &lt; 70</i>	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610
		7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
	ROUGH	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
		7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	





Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT15: RT-E-Mount Mini II - Rafter centered with 7/16 OSB and (6)-60 mm screws - 60 or 72 cells - Landscape Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>9.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ S <sub>s</sub> and S <sub>r</sub> from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
	ROUGH	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
<b>10.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ S <sub>s</sub> and S <sub>r</sub> from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
	ROUGH	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT16: RT-E-Mount Mini II - Rafter off-centered with 7/16 OSB and (5)-60 mm screws - 60 or 72 cells - Landscape Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
<b>0.50</b>  $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b>  $I_s = 1.0$ $C_b = 0.8$ $C_w = 1.0$ $C_a = 1.0$ $C_s = 1.0$ for α ≤ 30 deg $C_s = (70 - \alpha)/40$ for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914		
			S	2.438	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.914	0.610		
			C	2.134	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305		
		7 TO 27	R	2.438	2.438	2.438	1.829	1.524	1.219	0.914	0.914	0.914	0.610		
			S	2.438	2.134	1.524	1.219	0.914	0.610	0.610	0.610	0.610	0.305		
			C	2.438	1.524	0.914	0.610	0.610	0.305	0.305	0.305	0.305			
		28 TO 45	R	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914		
			S	2.438	2.438	2.438	2.134	1.829	1.524	1.219	0.914	0.914	0.610		
			C	2.438	2.438	2.438	2.134	1.829	1.524	1.219	0.914	0.914	0.610		
		ROUGH	0 TO 6	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	
				S	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914	
				C	2.438	2.134	1.524	1.219	0.914	0.610	0.610	0.305	0.305		
	7 TO 27		R	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914		
			S	2.438	2.438	2.134	1.829	1.524	1.219	0.914	0.914	0.610	0.610		
			C	2.438	2.134	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.305		
	28 TO 45		R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	
			S	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219		
			C	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219		
	<b>1.00</b>  $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b>  $I_s = 1.0$ $C_b = 0.8$ $C_w = 1.0$ $C_a = 1.0$ $C_s = 1.0$ for α ≤ 30 deg $C_s = (70 - \alpha)/40$ for 30 deg < α < 70 deg		OPEN	0 TO 6	R	1.829	1.829	1.829	1.829	1.524	1.219	0.914	0.914	0.610	
					S	1.829	1.829	1.829	1.829	1.524	1.219	0.914	0.914	0.305	0.305
					C	1.829	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305
		7 TO 27		R	2.134	2.134	2.134	1.829	1.524	1.219	0.914	0.914	0.914	0.610	
				S	2.134	2.134	1.524	1.219	0.914	0.610	0.610	0.610	0.610	0.305	
				C	2.134	1.524	0.914	0.610	0.610	0.305	0.305	0.305	0.305		
28 TO 45		R		2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.219	1.219	0.914		
		S		2.438	2.438	2.438	2.134	1.829	1.524	1.219	0.914	0.914	0.610		
		C		2.438	2.438	2.438	2.134	1.829	1.524	1.219	0.914	0.914	0.610		
ROUGH		0 TO 6		R	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	
				S	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.219	1.219	0.914	
				C	1.829	1.829	1.524	1.219	0.914	0.610	0.610	0.305	0.305		
		7 TO 27	R	2.134	2.134	2.134	2.134	2.134	1.829	1.524	1.219	1.219	0.914		
			S	2.134	2.134	2.134	1.829	1.524	1.219	0.914	0.914	0.610	0.610		
			C	2.134	2.134	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.305		
		28 TO 45	R	2.438	2.438	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.829	1.524	
			S	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219		
			C	2.438	2.438	2.438	2.438	2.438	2.134	1.829	1.524	1.524	1.219		
		<b>1.50</b>  $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b>  $I_s = 1.0$ $C_b = 0.8$ $C_w = 1.0$ $C_a = 1.0$ $C_s = 1.0$ for α ≤ 30 deg $C_s = (70 - \alpha)/40$ for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914
					S	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.914	0.610
					C	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305
7 TO 27				R	1.524	1.524	1.524	1.524	1.524	1.219	0.914	0.914	0.914	0.610	
				S	1.524	1.524	1.524	1.219	0.914	0.610	0.610	0.610	0.610	0.305	
				C	1.524	1.524	0.914	0.610	0.610	0.305	0.305	0.305	0.305		
28 TO 45	R			1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.219	1.219	0.914	
	S			1.829	1.829	1.829	1.829	1.829	1.524	1.219	0.914	0.914	0.610		
	C			1.829	1.829	1.829	1.829	1.829	1.524	1.219	0.914	0.914	0.610		
ROUGH	0 TO 6			R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	
				S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	
				C	1.219	1.219	1.219	1.219	0.914	0.610	0.610	0.610	0.305	0.305	
	7 TO 27		R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	1.219		
			S	1.524	1.524	1.524	1.524	1.524	1.219	0.914	0.914	0.610	0.610		
			C	1.524	1.524	1.524	1.219	0.914	0.610	0.610	0.610	0.610	0.305		
	28 TO 45		R	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	
			S	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.524	1.219	
			C	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.829	1.524	1.524	1.219	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT16: RT-E-Mount Mini II - Rafter off-centered with 7/16 OSB and (5)-60 mm screws - 60 or 72 cells - Landscape Orientation																	
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																	
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																	
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE $\alpha$ (deg.)	ROOF ZONE	BASIC WIND PRESSURE $q$ (1 IN 50) kPa													
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10				
<b>2.00</b> $S = Is(Ss^*Cb^*Cw^*Cs^*Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> $Is = 1.0$ $Cb = 0.8$ $Cw = 1.0$ $Ca = 1.0$ $Cs = 1.0$ for $\alpha \leq 30$ deg $Cs = (70 - \alpha)/40$ for $30 \text{ deg} < \alpha < 70$ deg	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914			
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610		
			C	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		7 TO 27	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.914	0.914	0.610		
			S	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.610	0.305		
			C	1.219	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305		
		28 TO 45	R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	1.219	1.219	0.914		
			S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219	0.914	0.914	0.914	0.914		
			C	1.524	1.524	1.524	1.524	1.524	1.524	1.219	0.914	0.914	0.914	0.914	0.914		
		ROUGH	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
				C	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305		
	7 TO 27		R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.914	0.610	0.610		
			C	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305		
	28 TO 45		R	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524		
			S	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219		
			C	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.524	1.219		
	<b>2.50</b> $S = Is(Ss^*Cb^*Cw^*Cs^*Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> $Is = 1.0$ $Cb = 0.8$ $Cw = 1.0$ $Ca = 1.0$ $Cs = 1.0$ for $\alpha \leq 30$ deg $Cs = (70 - \alpha)/40$ for $30 \text{ deg} < \alpha < 70$ deg		OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
					S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
					C	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305
		7 TO 27		R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	
				S	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	0.610	0.305	
				C	0.914	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
28 TO 45		R		1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914		
		S		1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.914	0.914		
		C		1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.914	0.914		
ROUGH		0 TO 6		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305		
		7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610		
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610		
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	0.305		
		28 TO 45	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
			S	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
			C	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219	1.219		
		<b>3.00</b> $S = Is(Ss^*Cb^*Cw^*Cs^*Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> $Is = 1.0$ $Cb = 0.8$ $Cw = 1.0$ $Ca = 1.0$ $Cs = 1.0$ for $\alpha \leq 30$ deg $Cs = (70 - \alpha)/40$ for $30 \text{ deg} < \alpha < 70$ deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
					S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
					C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305
7 TO 27				R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
28 TO 45	R			0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
	S			0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
	C			0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
ROUGH	0 TO 6			R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	
	7 TO 27		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305		
	28 TO 45		R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914		

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT16: RT-E-Mount Mini II - Rafter off-centered with 7/16 OSB and (5)-60 mm screws - 60 or 72 cells - Landscape Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>3.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
	<b>4.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305
			28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
<b>4.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT16: RT-E-Mount Mini II - Rafter off-centered with 7/16 OSB and (5)-60 mm screws - 60 or 72 cells - Landscape Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
<b>5.00</b> $S = Is(Ss * Cb * Cw * Cs * Ca + Sr)$ Ss and Sr from Code Tables <i>Suggested values</i> $I_s = 1.0$ $C_b = 0.8$ $C_w = 1.0$ $C_a = 1.0$ $C_s = 1.0$ for $\alpha \leq 30$ deg $C_s = (70 - \alpha)/40$ for $30 \text{ deg} < \alpha < 70$ deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
<b>5.50</b> $S = Is(Ss * Cb * Cw * Cs * Ca + Sr)$ Ss and Sr from Code Tables <i>Suggested values</i> $I_s = 1.0$ $C_b = 0.8$ $C_w = 1.0$ $C_a = 1.0$ $C_s = 1.0$ for $\alpha \leq 30$ deg $C_s = (70 - \alpha)/40$ for $30 \text{ deg} < \alpha < 70$ deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
<b>6.00</b> $S = Is(Ss * Cb * Cw * Cs * Ca + Sr)$ Ss and Sr from Code Tables <i>Suggested values</i> $I_s = 1.0$ $C_b = 0.8$ $C_w = 1.0$ $C_a = 1.0$ $C_s = 1.0$ for $\alpha \leq 30$ deg $C_s = (70 - \alpha)/40$ for $30 \text{ deg} < \alpha < 70$ deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT16: RT-E-Mount Mini II - Rafter off-centered with 7/16 OSB and (5)-60 mm screws - 60 or 72 cells - Landscape Orientation																		
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																		
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																		
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa														
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10					
<b>6.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305				
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
		<b>7.00</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	7 TO 27			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	28 TO 45			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	<b>7.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70			OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
						S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
						C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			7 TO 27		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
28 TO 45			R		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
ROUGH			0 TO 6		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT16: RT-E-Mount Mini II - Rafter off-centered with 7/16 OSB and (5)-60 mm screws - 60 or 72 cells - Landscape Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>8.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	ROUGH	0 TO 6	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
<b>8.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-		
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	ROUGH	0 TO 6	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
<b>9.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-		
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	
		7 TO 27	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	ROUGH	0 TO 6	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	
		7 TO 27	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT16: RT-E-Mount Mini II - Rafter off-centered with 7/16 OSB and (5)-60 mm screws - 60 or 72 cells - Landscape Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>9.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-		
		7 TO 27	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-		
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	ROUGH	0 TO 6	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-		
			C	-	-	-	-	-	-	-	-	-		
		7 TO 27	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-		
			C	-	-	-	-	-	-	-	-	-		
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
<b>10.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-		
			S	-	-	-	-	-	-	-	-	-		
			C	-	-	-	-	-	-	-	-			
		7 TO 27	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-		
			C	-	-	-	-	-	-	-	-			
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	ROUGH	0 TO 6	R	-	-	-	-	-	-	-	-	-		
			S	-	-	-	-	-	-	-	-			
			C	-	-	-	-	-	-	-	-			
		7 TO 27	R	-	-	-	-	-	-	-	-	-		
			S	-	-	-	-	-	-	-	-			
			C	-	-	-	-	-	-	-	-			
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			



Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT17: RT-E-Mount Mini II - Plywood Only - 60 or 72 cells - Landscape Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>0.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.610			
			S	2.438	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305			
			C	0.914	0.610	0.305	0.305	0.305	-	-	-	-				
		7 TO 27	R	2.438	1.524	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305		
			S	1.829	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	-		
			C	1.219	0.610	0.305	0.305	0.305	-	-	-	-	-			
		28 TO 45	R	2.438	2.438	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.305		
			S	2.438	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305			
			C	2.438	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305			
		<b>1.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.438	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.610	
					S	2.438	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	
					C	0.914	0.610	0.305	0.305	0.305	-	-	-	-		
	7 TO 27			R	2.438	1.524	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305	
				S	1.829	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	-	
				C	1.219	0.610	0.305	0.305	0.305	-	-	-	-	-		
	28 TO 45			R	2.438	2.438	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.305	
				S	2.438	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305		
				C	2.438	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305		
	<b>1.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	2.438	2.438	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.610
						S	2.438	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305
						C	0.914	0.610	0.305	0.305	0.305	-	-	-	-	
			7 TO 27		R	2.438	1.524	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305
					S	1.829	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	-
					C	1.219	0.610	0.305	0.305	0.305	-	-	-	-	-	
28 TO 45			R		1.829	1.829	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.305	
			S		1.829	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305		
			C		1.829	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305		
ROUGH			0 TO 6		R	2.438	2.438	2.438	2.134	1.524	1.219	1.219	0.914	0.914	0.610	0.610
					S	2.438	2.438	1.829	1.219	1.219	0.914	0.610	0.610	0.610	0.610	
					C	1.524	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	
			7 TO 27	R	2.438	2.438	1.829	1.524	1.219	0.914	0.610	0.610	0.610	0.610	0.610	
				S	2.438	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305		
				C	1.829	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305		
		28 TO 45	R	2.438	2.438	2.438	1.829	1.524	1.219	1.219	0.914	0.914	0.610	0.610		
			S	2.438	2.438	2.134	1.524	1.219	0.914	0.914	0.914	0.610	0.610			
			C	2.438	2.438	2.134	1.524	1.219	0.914	0.914	0.914	0.610	0.610			

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT17: RT-E-Mount Mini II - Plywood Only - 60 or 72 cells - Landscape Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
<b>2.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.829	1.829	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.610		
			S	1.829	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305		
			C	0.914	0.610	0.305	0.305	0.305	-	-	-	-			
		7 TO 27	R	2.134	1.524	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305	
			S	1.829	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-		
			C	1.219	0.610	0.305	0.305	0.305	-	-	-	-			
		28 TO 45	R	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.305	
			S	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305		
			C	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305		
	<b>2.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.524	1.524	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610	
				S	1.524	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	
				C	0.914	0.610	0.305	0.305	0.305	-	-	-	-		
			7 TO 27	R	1.524	1.524	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305	
				S	1.524	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	
				C	1.219	0.610	0.305	0.305	0.305	-	-	-	-		
			28 TO 45	R	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.305
				S	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
				C	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
<b>3.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610	
				S	1.219	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	
				C	0.914	0.610	0.305	0.305	0.305	-	-	-	-		
			7 TO 27	R	1.219	1.219	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305	
				S	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	
				C	1.219	0.610	0.305	0.305	0.305	-	-	-	-		
			28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	0.305
				S	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
				C	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
	ROUGH	0 TO 6	R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610		
			S	1.219	1.219	1.219	1.219	1.219	0.914	0.610	0.610	0.610	0.610		
			C	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-		
		7 TO 27	R	1.219	1.219	1.219	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	
			S	1.219	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305		
			C	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305		
		28 TO 45	R	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.914	0.610	0.610	0.610	
			S	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.914	0.610	0.610		
			C	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.914	0.610	0.610		

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT17: RT-E-Mount Mini II - Plywood Only - 60 or 72 cells - Landscape Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>3.50</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	
			S	0.914	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	
			C	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-	-	
		7 TO 27	R	1.219	1.219	1.219	0.914	0.610	0.610	0.610	0.305	0.305	0.305	
			S	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	
			C	1.219	0.610	0.305	0.305	0.305	0.305	-	-	-	-	
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	
	ROUGH	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	
			S	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	0.610	
			C	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	
		7 TO 27	R	1.219	1.219	1.219	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305
			S	1.219	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305
			C	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
<b>4.00</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	
			S	0.914	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	
			C	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-	-	
		7 TO 27	R	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305
			S	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	-
			C	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-	-	-
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305
	ROUGH	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	
			S	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	0.610	
			C	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	-
		7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	0.610
			S	0.914	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305
			C	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
<b>4.50</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	
			S	0.914	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	
			C	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-	-	
		7 TO 27	R	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	0.305	0.305
			S	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	-
			C	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-	-	-
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305
	ROUGH	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	0.610
			C	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-
		7 TO 27	R	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	0.610
			S	0.914	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305
			C	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT17: RT-E-Mount Mini II - Plywood Only - 60 or 72 cells - Landscape Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
<b>5.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305		
			C	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	-		
		7 TO 27	R	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	0.305		
			S	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-		
			C	0.914	0.610	0.305	0.305	0.305	-	-	-	-			
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305		
		ROUGH	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
				C	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-		
	7 TO 27		R	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	-		
			S	0.914	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305		
			C	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305		
	28 TO 45		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
	<b>5.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
					S	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
					C	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	-
		7 TO 27		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	
				S	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	
				C	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	-	
28 TO 45		R		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		S		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		C		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
ROUGH		0 TO 6		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
				C	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-		
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305		
			C	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305		
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		<b>6.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
					S	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
					C	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	-
7 TO 27				R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	
				S	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	
				C	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	-	
28 TO 45	R			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	S			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	C			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
ROUGH	0 TO 6			R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
				C	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-		
	7 TO 27		R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305		
			C	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305		
	28 TO 45		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT17: RT-E-Mount Mini II - Plywood Only - 60 or 72 cells - Landscape Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
<b>6.50</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610		
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305		
			C	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	-		
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	
			S	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-	
			C	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	<b>7.00</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-
			7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
				S	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-
				C	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	-	-
			28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
<b>7.50</b> $S = Is(Ss \cdot Cb \cdot Cw \cdot Cs \cdot Ca + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70		OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-
			7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
				S	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-
				C	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	-	-
			28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	
			S	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT17: RT-E-Mount Mini II - Plywood Only - 60 or 72 cells - Landscape Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE $\alpha$ (deg.)	ROOF ZONE	BASIC WIND PRESSURE $q$ (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
<b>8.00</b> $S = Is(Ss^*Cb^*Cw^*Cs^*Ca + Sr)$ Ss and Sr from Code Tables Suggested values Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for $\alpha \leq 30$ deg Cs = (70 - $\alpha$ )/40 for 30 deg < $\alpha$ < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	-
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
	7 TO 27	R			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		S			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
		C			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	28 TO 45	R		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		S		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		C		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
ROUGH		0 TO 6		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	
	7 TO 27		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	
7 TO 27	R			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	S			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	C			0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
28 TO 45	R		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	S		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	C		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
	ROUGH		0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	
7 TO 27		R		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		S		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		C		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
28 TO 45		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT17: RT-E-Mount Mini II - Plywood Only - 60 or 72 cells - Landscape Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE $\alpha$ (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
<b>9.50</b> $S = I_s(S_e C_b C_w C_s C_a + S_r)$ S <sub>s</sub> and S <sub>r</sub> from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for $\alpha \leq 30$ deg C <sub>s</sub> = $(70 - \alpha)/40$ for $30 \text{ deg} < \alpha < 70$	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	-		
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	
			C	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	-		
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	
	7 TO 27		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	28 TO 45		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	<b>10.00</b> $S = I_s(S_e C_b C_w C_s C_a + S_r)$ S <sub>s</sub> and S <sub>r</sub> from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for $\alpha \leq 30$ deg C <sub>s</sub> = $(70 - \alpha)/40$ for $30 \text{ deg} < \alpha < 70$		OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
					C	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	-
		7 TO 27		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-
28 TO 45		R		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		S		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		C		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
ROUGH		0 TO 6		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT18: RT-E-Mount Mini II - OSB Only - 60 or 72 cells - Landscape Orientation																	
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																	
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																	
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa													
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10				
<b>0.50</b> $S = Is(SsCbCwCsCa + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	2.438	2.134	1.524	0.914	0.914	0.610	0.610	0.610	0.305	0.305				
			S	2.438	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.914	0.610	0.305	0.305	-	-	-	-	-	-	-			
		7 TO 27	R	2.438	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305			
			S	1.524	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-	-			
			C	0.914	0.610	0.305	0.305	0.305	-	-	-	-	-	-			
		28 TO 45	R	2.438	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305			
			S	2.438	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305			
			C	2.438	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305			
		<b>1.00</b> $S = Is(SsCbCwCsCa + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	1.829	1.829	1.524	0.914	0.914	0.610	0.610	0.610	0.305	0.305		
					S	1.829	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.914	0.610	0.305	0.305	-	-	-	-	-	-	-	
	7 TO 27			R	2.134	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305		
				S	1.524	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-	-		
				C	0.914	0.610	0.305	0.305	0.305	-	-	-	-	-	-		
	28 TO 45			R	2.438	1.829	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305		
				S	2.438	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305		
				C	2.438	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305		
	<b>1.50</b> $S = Is(SsCbCwCsCa + Sr)$ Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg			OPEN	0 TO 6	R	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
						S	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305
						C	0.914	0.610	0.305	0.305	-	-	-	-	-	-	-
			7 TO 27		R	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	
					S	1.524	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-	-	
					C	0.914	0.610	0.305	0.305	0.305	-	-	-	-	-	-	
28 TO 45			R		1.524	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305		
			S		1.524	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305		
			C		1.524	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305		
ROUGH			0 TO 6		R	1.219	1.219	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	
					S	1.219	1.219	1.219	1.219	0.914	0.610	0.610	0.610	0.610	0.305	0.305	
					C	1.219	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-	-	
			7 TO 27	R	1.524	1.524	1.524	1.219	0.914	0.610	0.610	0.610	0.610	0.305	0.305		
				S	1.524	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305		
				C	1.524	0.914	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-	-		
		28 TO 45	R	1.524	1.524	1.524	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610			
			S	1.524	1.524	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.610			
			C	1.524	1.524	1.524	1.219	0.914	0.914	0.610	0.610	0.610	0.610	0.610			



Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT18: RT-E-Mount Mini II - OSB Only - 60 or 72 cells - Landscape Orientation

MAXIMUM SPACING OF RT-E MOUNT MINI (m)

SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY

SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>2.00</b> S = Is(Ss'Cb'Cw'Cs'Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
			S	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
			C	0.914	0.610	0.305	0.305	-	-	-	-	-	-	
		7 TO 27	R	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
			S	1.219	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-	
			C	0.914	0.610	0.305	0.305	0.305	-	-	-	-	-	
		28 TO 45	R	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
			S	1.219	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	
			C	1.219	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	
	ROUGH	0 TO 6	R	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305
			S	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
			C	0.914	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-	
		7 TO 27	R	1.219	1.219	1.219	1.219	0.914	0.610	0.610	0.610	0.305	0.305	
			S	1.219	1.219	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
			C	1.219	0.914	0.610	0.305	0.305	0.305	0.305	0.305	-	-	
		28 TO 45	R	1.219	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	
			S	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610	
			C	1.219	1.219	1.219	1.219	0.914	0.914	0.610	0.610	0.610	0.610	
<b>2.50</b> S = Is(Ss'Cb'Cw'Cs'Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	
			S	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
			C	0.610	0.610	0.305	0.305	-	-	-	-	-	-	
		7 TO 27	R	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
			S	0.914	0.914	0.610	0.305	0.305	0.305	0.305	-	-	-	
			C	0.914	0.610	0.305	0.305	0.305	-	-	-	-	-	
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
			S	0.914	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	
			C	0.914	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	
	ROUGH	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	
			C	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	
		7 TO 27	R	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	0.305	0.305	
			S	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
			C	0.914	0.914	0.610	0.305	0.305	0.305	0.305	0.305	-	-	
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	
<b>3.00</b> S = Is(Ss'Cb'Cw'Cs'Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	
			S	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
			C	0.610	0.610	0.305	0.305	-	-	-	-	-	-	
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
			S	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	
			C	0.610	0.610	0.305	0.305	0.305	-	-	-	-	-	
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.305	0.305	
			S	0.914	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	
			C	0.914	0.914	0.914	0.914	0.610	0.610	0.305	0.305	0.305	0.305	
	ROUGH	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	
			C	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	
			S	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
			C	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	-	-	
		28 TO 45	R	0.914	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	
			S	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	
			C	0.914	0.914	0.914	0.914	0.914	0.914	0.610	0.610	0.610	0.610	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT18: RT-E-Mount Mini II - OSB Only - 60 or 72 cells - Landscape Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
<b>3.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305		
			S	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.610	0.610	0.305	0.305	-	-	-	-	-	-	-	
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	-	
			C	0.610	0.610	0.305	0.305	0.305	-	-	-	-	-	-	
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	
	<b>4.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	-	-	-	-	-	-	-
			7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.610	0.610	0.610	0.305	0.305	0.305	0.305	-	-	-	-
				C	0.610	0.610	0.305	0.305	0.305	-	-	-	-	-	-
			28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305
<b>4.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	-	-	-	-	-	-	-
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	-
				C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-
			28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305
				S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305
				C	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	-	
		7 TO 27	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.305	0.305	
			S	0.610	0.610	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.610	0.610	0.610	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
		28 TO 45	R	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			S	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	
			C	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	0.610	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT18: RT-E-Mount Mini II - OSB Only - 60 or 72 cells - Landscape Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
<b>5.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C	0.305	0.305	0.305	0.305	-	-	-	-	-	-		
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	
			C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-		
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	<b>5.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				C	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-
				C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	
			28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
<b>6.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α <= 30 deg Cs = (70 - α)/40 for 30 deg < α < 70 deg		OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				C	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-
				C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	
			28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	ROUGH	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-		
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT18: RT-E-Mount Mini II - OSB Only - 60 or 72 cells - Landscape Orientation																
MAXIMUM SPACING OF RT-E MOUNT MINI (m)																
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY																
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa												
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10			
<b>6.50</b> $S = I_s(S_e C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305			
			C	0.305	0.305	0.305	0.305	-	-	-	-	-	-			
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-		
			C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-			
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
		<b>7.00</b> $S = I_s(S_e C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
	7 TO 27			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	
				C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-		
	28 TO 45			R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	<b>7.50</b> $S = I_s(S_e C_b C_w C_s C_a + S_r)$ Ss and Sr from Code Tables <b>Suggested values</b> I <sub>s</sub> = 1.0 C <sub>b</sub> = 0.8 C <sub>w</sub> = 1.0 C <sub>a</sub> = 1.0 C <sub>s</sub> = 1.0 for α ≤ 30 deg C <sub>s</sub> = (70 - α)/40 for 30 deg < α < 70			OPEN	0 TO 6	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
						S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
						C	0.305	0.305	0.305	0.305	-	-	-	-	-	-
			7 TO 27		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-
					C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	
28 TO 45			R		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C		0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
ROUGH			0 TO 6		R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
					C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305		

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT18: RT-E-Mount Mini II - OSB Only - 60 or 72 cells - Landscape Orientation															
MAXIMUM SPACING OF RT-E MOUNT MINI (m)															
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY															
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa											
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10		
<b>8.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-	-		
			S	-	-	-	-	-	-	-	-	-	-		
			C	-	-	-	-	-	-	-	-	-	-		
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-	-	
			C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
	<b>8.50</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-		
				S	-	-	-	-	-	-	-	-	-	-	
				C	-	-	-	-	-	-	-	-	-	-	
			7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	-
				C	0.305	0.305	0.305	0.305	0.305	-	-	-	-	-	-
			28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
<b>9.00</b> S = Is(Ss*Cb*Cw*Cs*Ca + Sr) Ss and Sr from Code Tables <b>Suggested values</b> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70		OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-		
				S	-	-	-	-	-	-	-	-	-	-	
				C	-	-	-	-	-	-	-	-	-	-	
			7 TO 27	R	-	-	-	-	-	-	-	-	-	-	-
				S	-	-	-	-	-	-	-	-	-	-	-
				C	-	-	-	-	-	-	-	-	-	-	-
			28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
				C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	ROUGH	0 TO 6	R	-	-	-	-	-	-	-	-	-	-		
			S	-	-	-	-	-	-	-	-	-	-		
			C	-	-	-	-	-	-	-	-	-	-		
		7 TO 27	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	-	-	
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

Table: RT18: RT-E-Mount Mini II - OSB Only - 60 or 72 cells - Landscape Orientation														
MAXIMUM SPACING OF RT-E MOUNT MINI (m)														
SPACING OF MOUNTS MUST NOT EXCEED THE MAXIMUM RECOMMENDED SPACING FOR THE RAILS USED AND THE RAFTER CAPACITY														
SNOW & RAIN LOAD (kPa)	TERRAIN	ROOF ANGLE α (deg.)	ROOF ZONE	BASIC WIND PRESSURE q (1 IN 50) kPa										
				0.20	0.30	0.40	0.50	0.60	0.70	0.80	0.90	1.00	1.10	
<b>9.50</b> $S = I_s(S_s \cdot C_b \cdot C_w \cdot C_s \cdot C_a + S_r)$ Ss and Sr from Code Tables <i>Suggested values</i> Is = 1.0 Cb = 0.8 Cw = 1.0 Ca = 1.0 Cs = 1.0 for α ≤ 30 deg Cs = (70 - α)/40 for 30 deg < α < 70	OPEN	0 TO 6	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	
		7 TO 27	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
	ROUGH	0 TO 6	R	-	-	-	-	-	-	-	-	-	-	
			S	-	-	-	-	-	-	-	-	-	-	
			C	-	-	-	-	-	-	-	-	-	-	
		7 TO 27	R	-	-	-	-	-	-	-	-	-	-	-
			S	-	-	-	-	-	-	-	-	-	-	-
			C	-	-	-	-	-	-	-	-	-	-	-
		28 TO 45	R	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			S	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305
			C	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305	0.305

---

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021 Design: SA

---

Project No.: 20027-T2

Description

Calculation of mount capacities

Checker: MG

---

## EXHIBIT – A

Project Name: RT-MINI II-BC (BCBC2018)

Date : 18/05/2021


Design: SA

Project No.: 20027-T2


Description

Calculation of mount capacities

Checker: MG

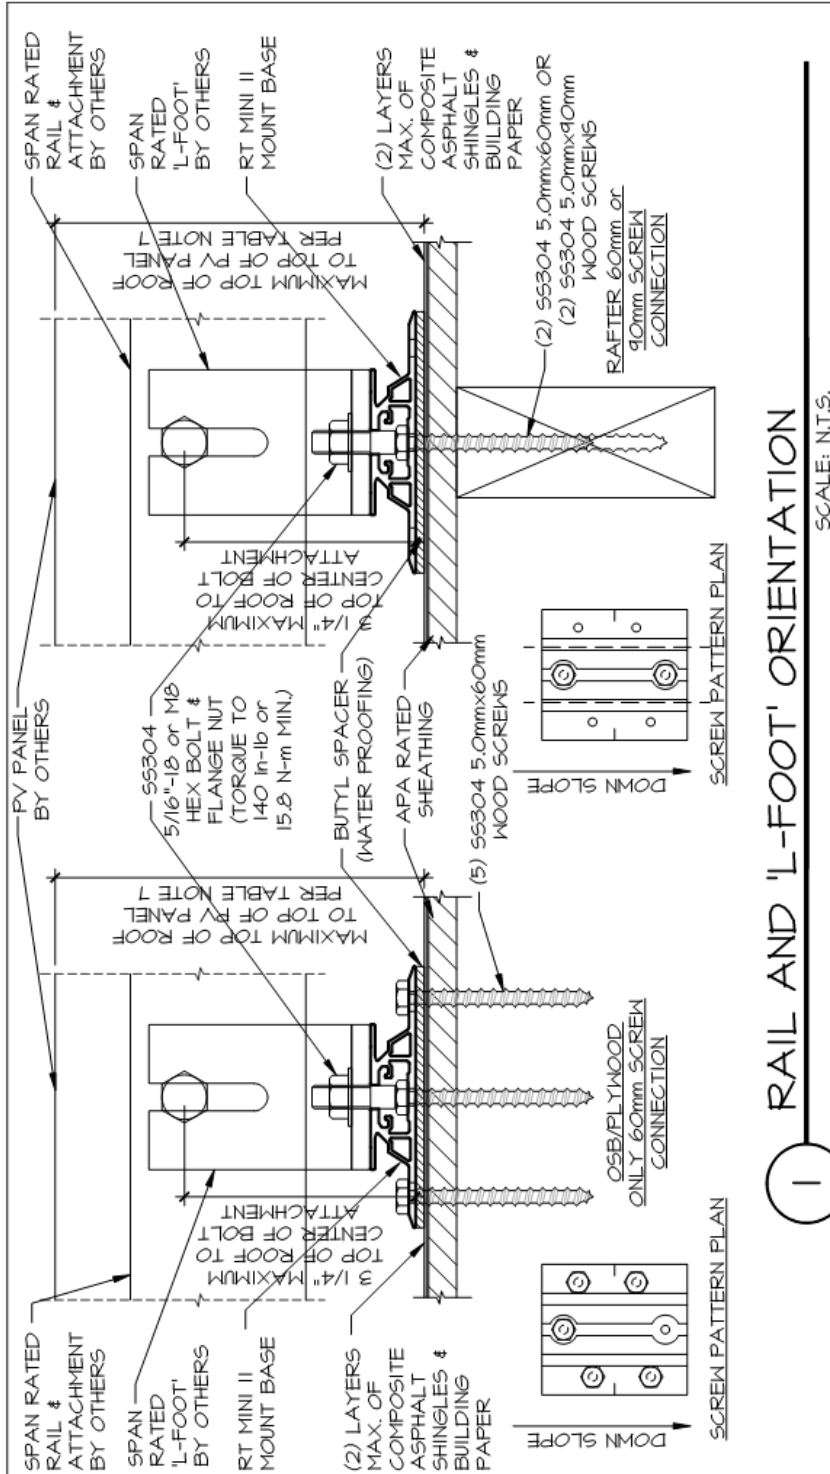

1 RAIL AND 'L-FOOT' ORIENTATION  
SCALE: N.T.S.

<p><b>Starling Madison Lofquist, Inc.</b> 5224 S. 39th Street Phoenix, Arizona 85040 (602) 438-2500 fax. (602) 438-2505</p>  <p>Consulting Structural and Forensic Engineers</p>	<p>ROOF TECH RT MINI II MOUNT WITH L-FOOT, RAILS, &amp; PV PANELS BY OTHERS</p>	<p>ROOF TECH, INC. 10620 TREENA ST., SUITE 230 SAN DIEGO, CA 92131</p>	<p>DATE: 5-7-2021 JOB NO: 471-13</p>	<p>EXHIBIT A1</p>
	<p>DRAWN BY: J.S. DESIGNED BY: J.L.</p>	<p>DATE: 5-7-2021 JOB NO: 471-13</p>		



Project Name: RT-MINI II-BC (BCBC2018)


Date : 18/05/2021 Design: SA

Project No.: 20027-T2


Description

Calculation of mount capacities

Checker: MG

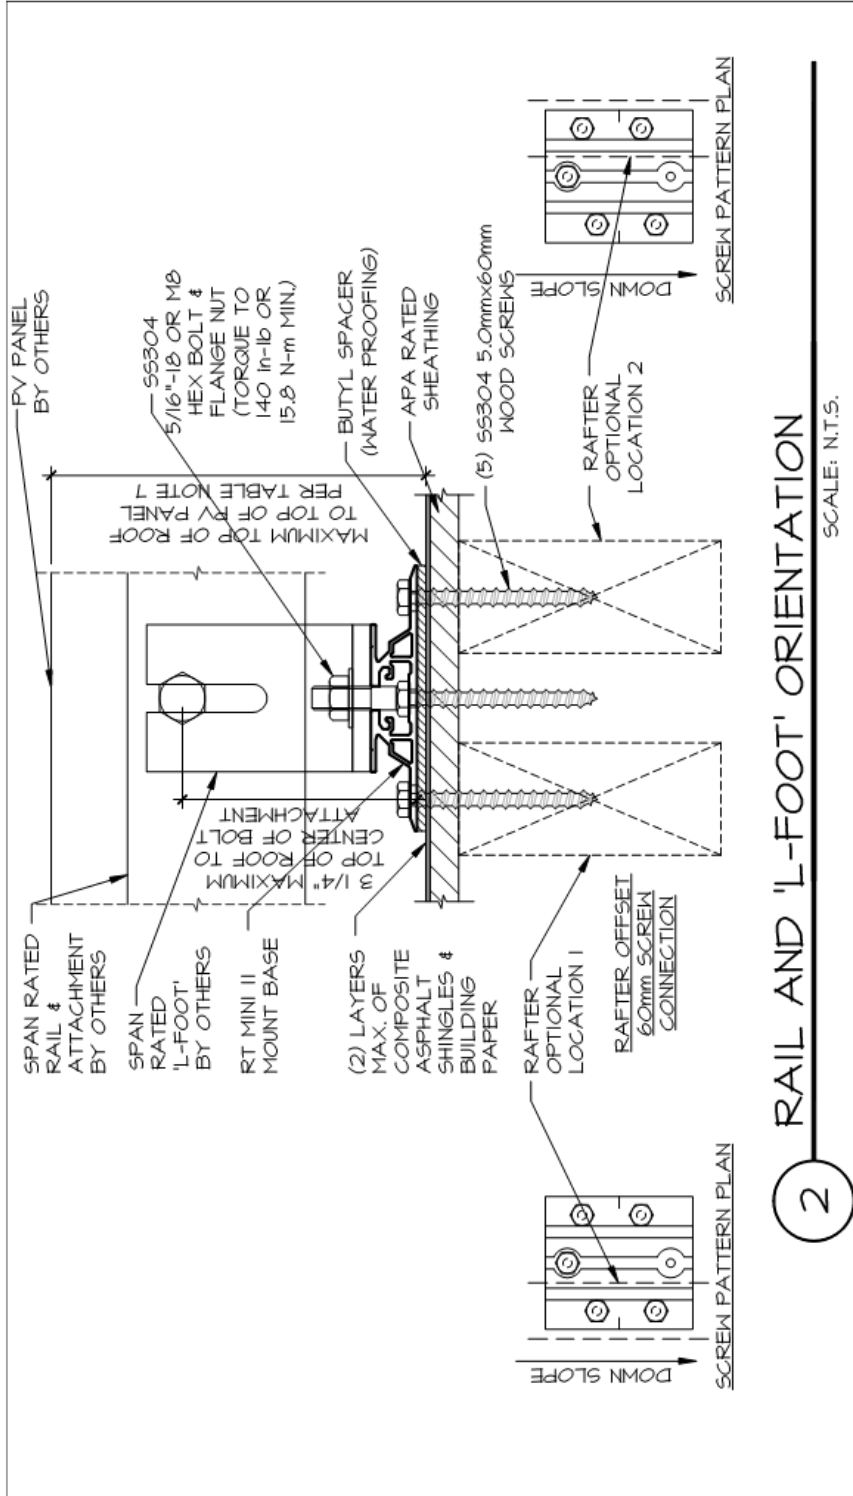


<p>Starling Madison Lofquist, Inc. 5224 S. 39th Street Phoenix, Arizona 85040 (602) 438-2500 fax. (602) 438-2505</p>	<p>ROOF TECH RT MINI II MOUNT WITH L-FOOT, RAILS, &amp; PV PANELS BY OTHERS</p>	<p>ROOF TECH, INC. 10620 TREENA ST., SUITE 230 SAN DIEGO, CA 92131</p>
<p>DRAWN BY: J.S.      DATE: 5-7-2021</p> <p>DESIGNED BY: J.L.      JOB NO: 471-13</p>		<p><b>EXHIBIT A2</b></p>

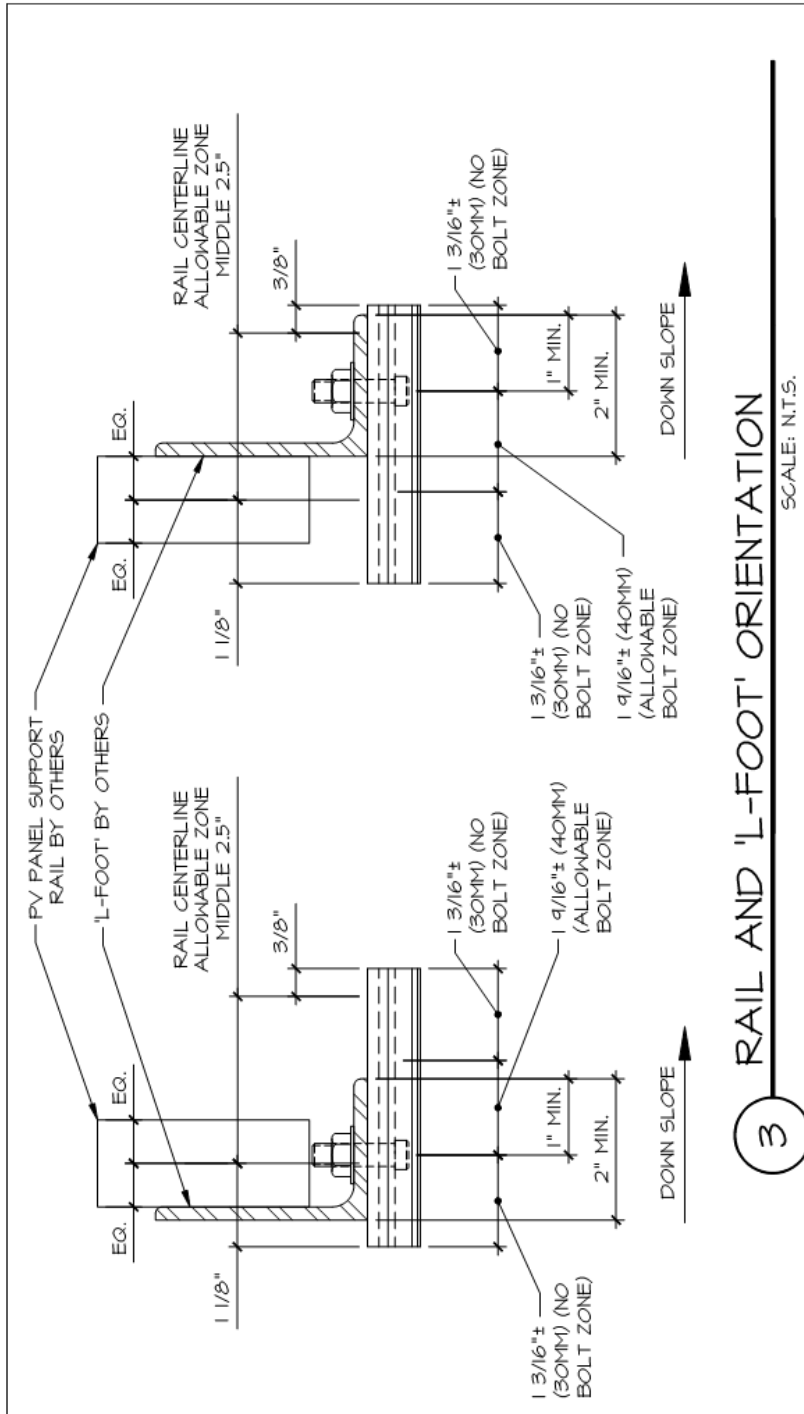


3 RAIL AND 'L-FOOT' ORIENTATION  
SCALE: N.T.S.

<p>Starling Madison Lofquist, Inc. 5224 S. 39th Street Phoenix, Arizona 85040 (602) 438-2500 fax. (602) 438-2505</p>	<p>J.S. DATE: 5-7-2021</p>	<p>EXHIBIT A3</p>
	<p>D.H. JOB NO: 471-13</p>	
<p>ROOF TECH RT MINI II MOUNT WITH L-FOOT, RAILS, &amp; PV PANELS BY OTHERS</p>	<p>ROOF TECH, INC. 10620 TREENA ST., SUITE 230 SAN DIEGO, CA 92131</p>	

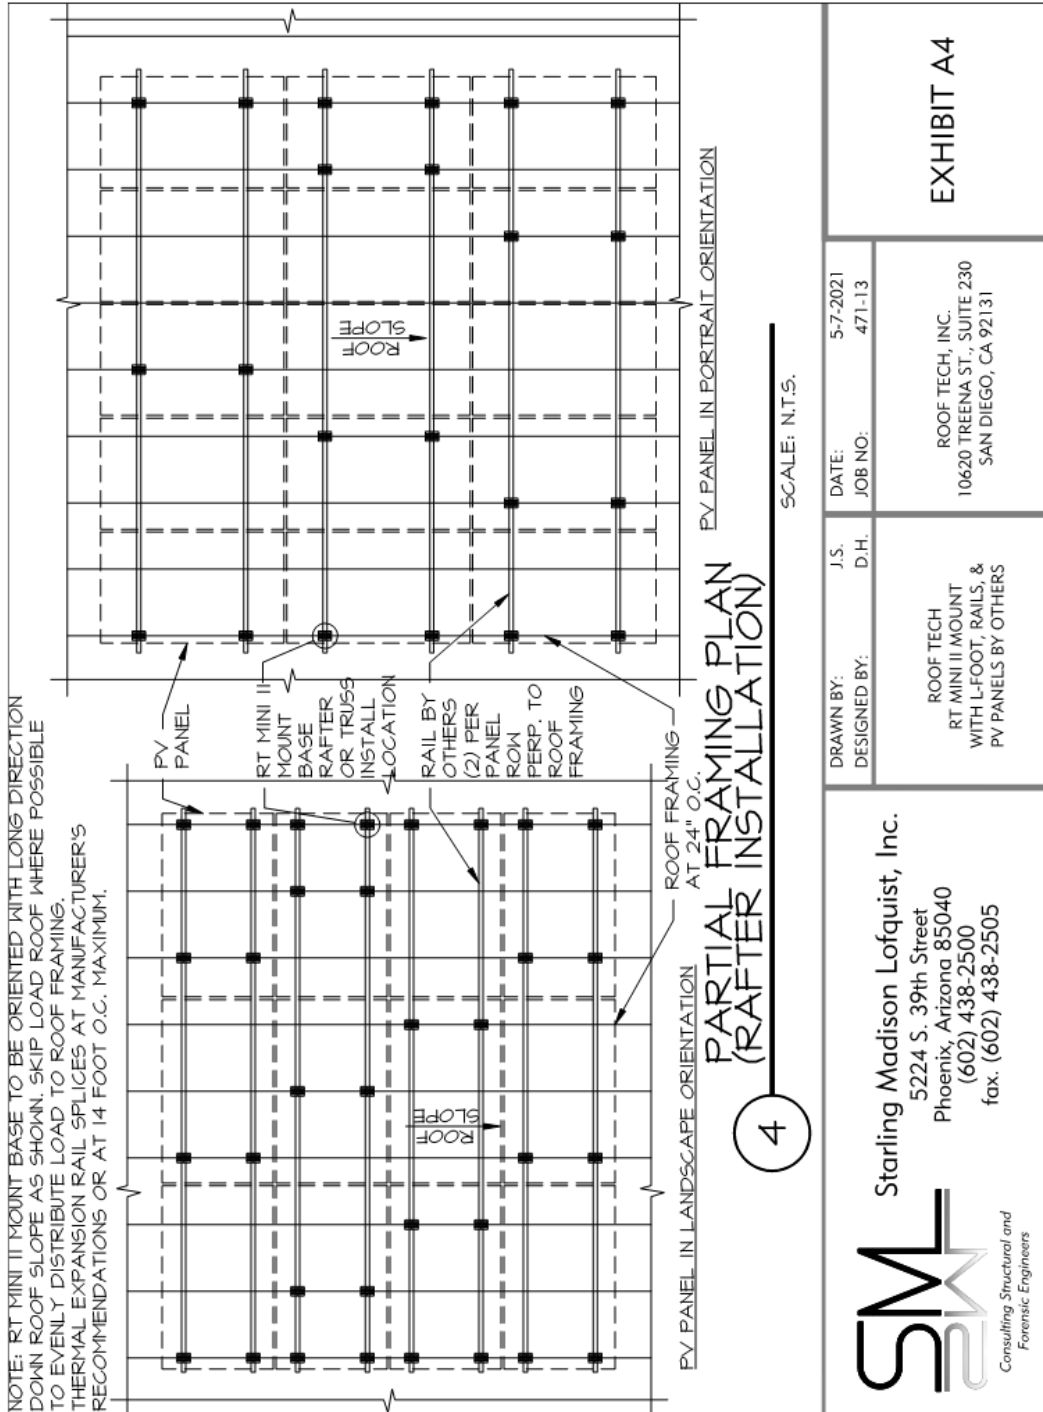

DRAWN BY: J.S.		DATE: 5-7-2021	EXHIBIT A4
DESIGNED BY: D.H.		JOB NO: 471-13	
ROOF TECH RT MINI II MOUNT WITH L-FOOT, RAILS, & PV PANELS BY OTHERS		ROOF TECH, INC. 10620 TREEANA ST., SUITE 230 SAN DIEGO, CA 92131	
<p>Starling Madison Lofquist, Inc. 5224 S. 39th Street Phoenix, Arizona 85040 (602) 438-2500 fax. (602) 438-2505</p> <p><b>SML</b> Consulting Structural and Forensic Engineers</p>			

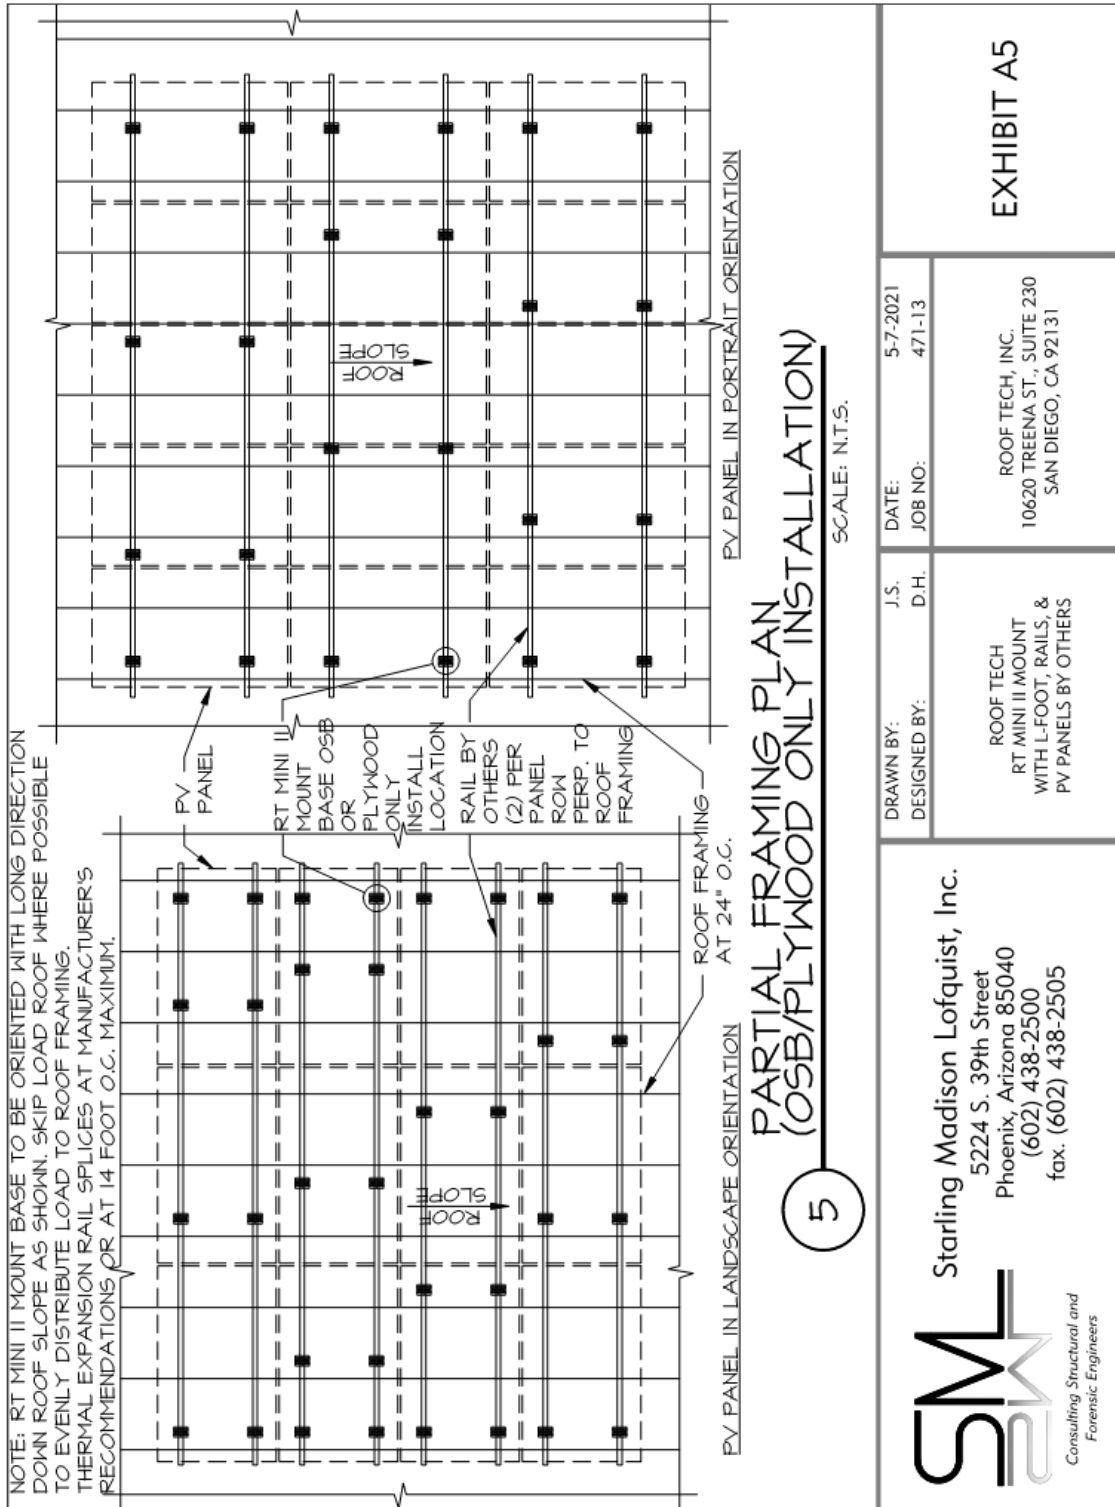

DRAWN BY: J.S. DESIGNED BY: D.H.	DATE: 5-7-2021 JOB NO: 471-13	EXHIBIT A5
	ROOF TECH RT MINI II MOUNT WITH L-FOOT, RAILS, & PV PANELS BY OTHERS	
Stirling Madison Lofquist, Inc. 5224 S. 39th Street Phoenix, Arizona 85040 (602) 438-2500 fax. (602) 438-2505		